



# Drawing Change Notice

Page 1 of 8

CHANGE DOCUMENT NO.  
24590-LAW-P1N-P01T-00057

JOB NO. 24590	TITLE FOR CHANGE NOTICE REVISION TO LAW UPS BATTERY ROOM LAYOUT
------------------	--

DESIGN DOCUMENT NUMBER	REV	DESIGN DOCUMENT NUMBER	REV
24590-LAW-P1-P01T-00004	4		
24590-LAW-P1-P01T-00005	3		

PART OF DESIGN CHANGE PACKAGE (DCP)?  Yes  No DCP No.: \_\_\_\_\_ Rev: \_\_\_\_\_

JUSTIFICATION FOR CHANGE INCORPORATE VENDOR DATA FOR SS ACU TO COMPLETE ACTIONS IN 24590-WTP-RITS-QAIS-06-0792. INCORPORATE UPDATED SELLER DESIGN REQUIREMENTS AND ALIGN DESIGN DOCUMENTS.	CAUSE CODE 31
---	------------------

Supersedes Change Document  Yes  No

ECN Needed  Yes  No

### REQUIREMENTS REVIEW

Client Approval Required  Yes  No Interface Resolution Required \*  Yes  No

*Address any "yes" answers in the description*

DESCRIPTION OF CHANGE

**NOTES**

- REFER TO 24590-LAW-P1N-P23T-00058 FOR ADDITIONAL DETAILS AND CALLOUTS
- LABELS FOR MINOR ELECTRICAL AND C&I COMPONENTS (PANELS, TRANSFORMERS, RACKS, AND ENCLOSURES) HAVE BEEN OMITTED FOR CLARITY. REFER TO APPROPRIATE EQUIPMENT LOCATION PLAN FOR LABEL INFORMATION.

**L-0313 (SEE PAGE 4)**

- REMOVED HOLD CLOUD 14 FOR C2V-ACU-00003
- REVISED SIZE OF C2V-ACU-00003
- REVISED SIZES OF UPE-BATT-20301 AND UPE-UPS-20301
- RELOCATED UPE-XFMR-20350, UPE-PNL-20350, LVP-PNL-20322, LVP-XFMR-20322 FROM CORRIDOR LC0310 (NOTE 1)
- ADDED SS HVAC CONTROL PANELS C2V-PNL-00116 AND C3V-PNL-00015 (NOTE 1)
- DELETED SECTION OF UPE-BATT-20301 AT COLUMN 4
- ADDED BATTERY RACK DISCONNECT SWITCH UPE-SW-20301 (NOTE 1)

**LC0310 (SEE PAGE 4)**

- REMOVED HOLD CLOUD 14 FOR C2V-COND-00003
- RELOCATED C2V-COND-00003 TO EXTERIOR PLATFORM. (PAGE 5)
- DELETED LVE-ENCL-000023 TO ALIGN WITH C&I DESIGN DOCUMENTS (NOTE 1)
- RELOCATED UPE-XFMR-20350, UPE-PNL-20350, LVP-PNL-20322, LVP-XFMR-20322 TO L-0313 (NOTE 1)



# Drawing Change Notice

Page 2 of 8

CHANGE DOCUMENT NO.  
24590-LAW-P1N-P01T-00057

JOB NO. 24590	TITLE FOR CHANGE NOTICE REVISION TO LAW UPS BATTERY ROOM LAYOUT
------------------	--

## DESCRIPTION OF CHANGE

### L-0311 (SEE PAGE 4)

1. REMOVED HOLD CLOUD 14 FOR C2V-ACU-00002
2. REVISED SIZE OF C2V-ACU-00002
3. REVISED SIZES OF UPE-BATT-20302 AND UPE-UPS-20302
4. RELOCATED UPE-XFMR-20351, UPE-PNL-20351 FROM CORRIDOR LC0306 (NOTE 1)
5. ADDED SS HVAC CONTROL PANELS C2V-PNL-00115 AND C3V-PNL-00014 (NOTE 1)
6. DELETED SECTION OF UPE-BATT-20302 AT COLUMN 9
7. ADDED BATTERY RACK DISCONNECT SWITCH UPE-SW-20302 (NOTE 1)

### LC0306 (SEE PAGE 4)

1. REMOVED HOLD CLOUD 14 FOR C2V-COND-00002
2. RELOCATED C2V-COND-00002 TO EXTERIOR PLATFORM. (PAGE 5)
3. RELOCATED UPE-XFMR-20351, UPE-PNL-20351 TO L-0311 (NOTE 1)
4. RELOCATED EMJ-ENCL-00008 TO COLUMN K13. (NOT SHOWN ON THIS DCN)
5. ADDED FPW-CAB-00001 (NOTE 1)
6. ADDED LVE-ENCL-00002 (NOTE 1)

### L-0309 (SEE PAGE 4)

1. REMOVED HOLD CLOUD 14 FOR C2V-ACU-00001
2. REVISED SIZE OF C2V-ACU-00001
3. REVISED SIZES OF UPE-BATT-20303 AND UPE-UPS-20303
4. RELOCATED LVE-PNL-20323, LVE-XFMR-20323, LTE-PNL-20301, LTE-XFME-20301 FROM CORRIDOR LC0310 (NOTE 1)
5. ADDED SS HVAC CONTROL PANELS C2V-PNL-00114 AND C3V-PNL-00013 (NOTE 1)
6. DELETED SECTION OF UPE-BATT-20303 AT COLUMN 12
7. ADDED BATTERY RACK DISCONNECT SWITCH UPE-SW-20303 (NOTE 1)

### LC0305 (SEE PAGE 4)

1. REMOVED HOLD CLOUD 14 FOR C2V-COND-00001
2. RELOCATED C2V-COND-00001 TO EXTERIOR PLATFORM (PAGE 5)
3. RELOCATED LTE-PNL-20301, LTE-XFMR-20301, LVE-PNL-20323, LVE-XFME-20323, LVE-PNL-20324, LVE-XFMR-20324 TO L-0309 (NOTE 1)

### EXTERIOR CONDENSER PLATFORM (SEE PAGE 5)

1. REMOVED HOLD CLOUD 16



# Drawing Change Notice

Page 3 of 8

CHANGE DOCUMENT NO.  
24590-LAW-P1N-P01T-00057

JOB NO. 24590	TITLE FOR CHANGE NOTICE REVISION TO LAW UPS BATTERY ROOM LAYOUT
------------------	--

## DESCRIPTION OF CHANGE

### **ROOM L-0304C (SEE PAGES 6 AND 7)**

1. REMOVED HOLD 18, REVISED AND RELOCATED C3V-ACU-00001
2. RELOCATED LVP-ASD-00001A
3. REVISED PRELIMINARY SIZE OF LVP-EXHR-00001A AND ADDED HOLD 19 PENDING RECEIPT OF NEW CODE 2 SUBMITTALS
4. CORRECTED LABEL FROM C3V-ACU-00001 TO C3V-ACU-00003

### **ROOM L-0304D (SEE PAGES 6 AND 7)**

1. REMOVED HOLD 18, REVISED AND RELOCATED C3V-ACU-00002
2. RELOCATED LVP-ASD-00001B
3. REVISED PRELIMINARY SIZE OF LVP-EXHR-00001B AND ADDED HOLD 19 PENDING RECEIPT OF NEW CODE 2 SUBMITTALS

### **ROOM L-0304E (SEE PAGES 6 AND 7)**

1. REMOVED HOLD 18, REVISED AND RELOCATED C3V-ACU-00003
2. RELOCATED LVP-ASD-00001C
3. REVISED PRELIMINARY SIZE OF LVP-EXHR-00001C AND ADDED HOLD 19 PENDING RECEIPT OF NEW CODE 2 SUBMITTALS
4. CORRECTED LABEL FROM C3V-ACU-00003 TO C3V-ACU-00001




# Drawing Change Notice

Page 4 of 8


CHANGE DOCUMENT NO.  
24590-LAW-P1N-P01T-00057

JOB NO. 24590	TITLE FOR CHANGE NOTICE REVISION TO LAW UPS BATTERY ROOM LAYOUT
------------------	--

## DESCRIPTION OF CHANGE

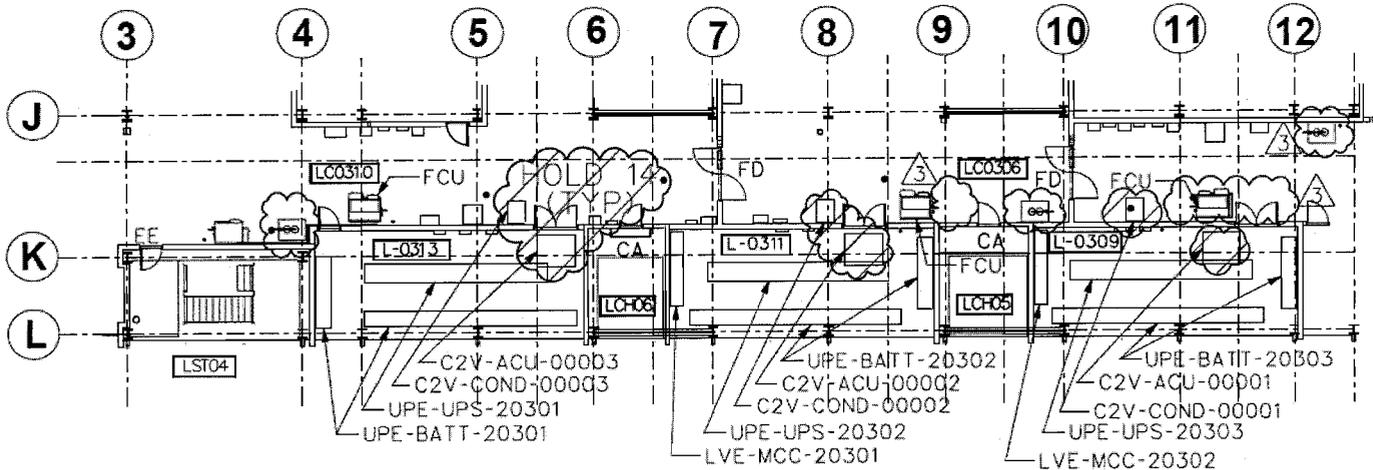

**CURRENT LAYOUT**  
**24590-LAW-P1-P01T-00005 REV. 3**  
**24590-LAW-P1N-P01T-00057**

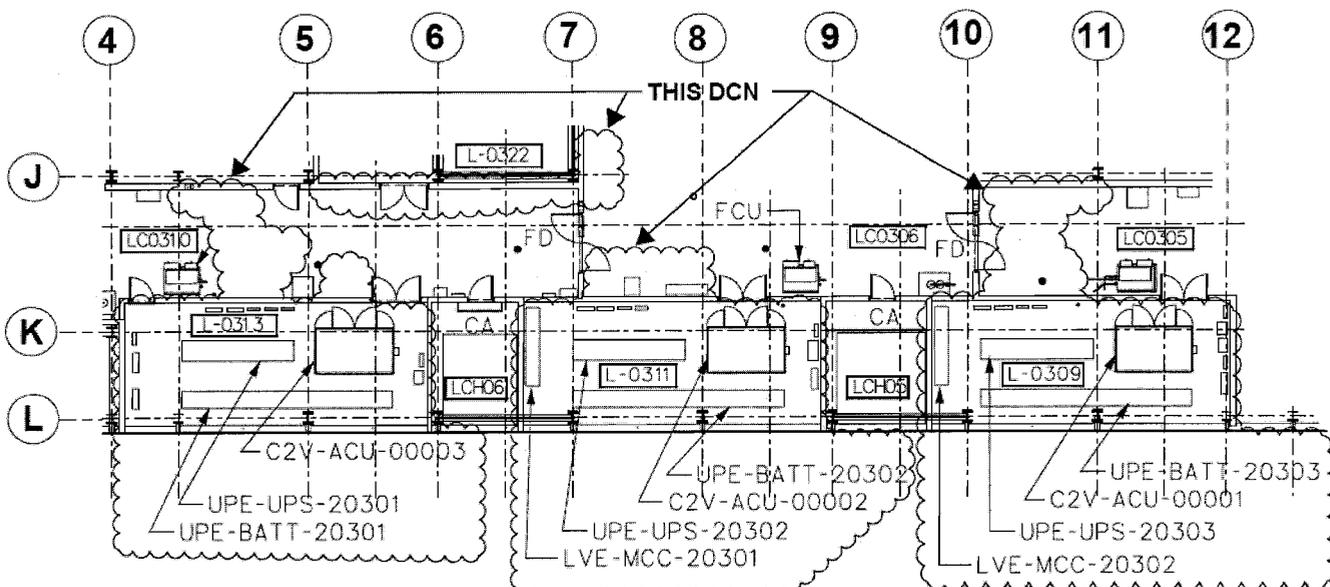

**REVISED LAYOUT**  
**24590-LAW-P1-P01T-00005 REV. 3**  
**24590-LAW-P1N-P01T-00057**




# Drawing Change Notice

Page 5 of 8


CHANGE DOCUMENT NO.  
24590-LAW-P1N-P01T-00057

JOB NO. 24590	TITLE FOR CHANGE NOTICE REVISION TO LAW UPS BATTERY ROOM LAYOUT
------------------	--

## DESCRIPTION OF CHANGE

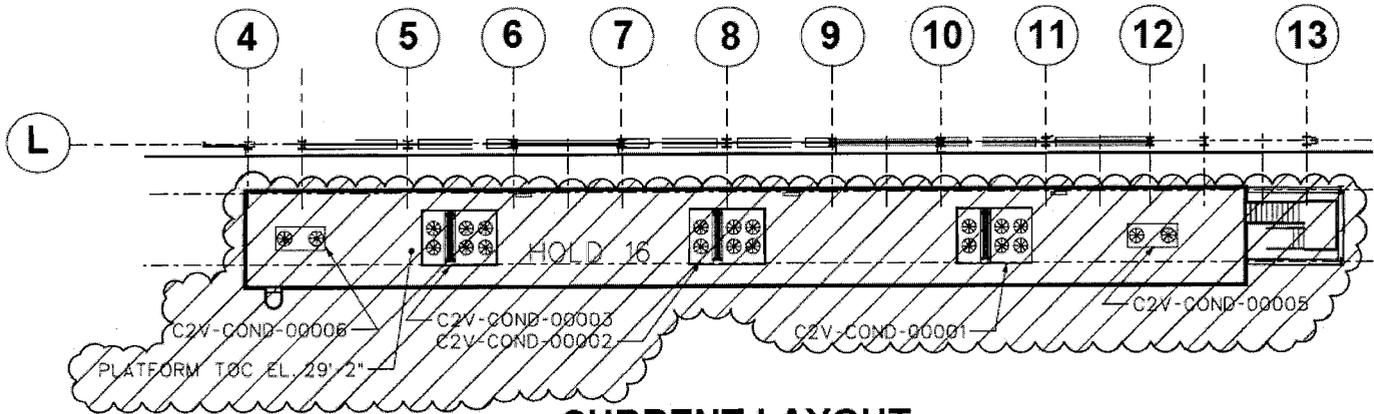

**CURRENT LAYOUT**  
**24590-LAW-P1-P01T-00004 REV. 4**  
**24590-LAW-P1N-P01T-00057**

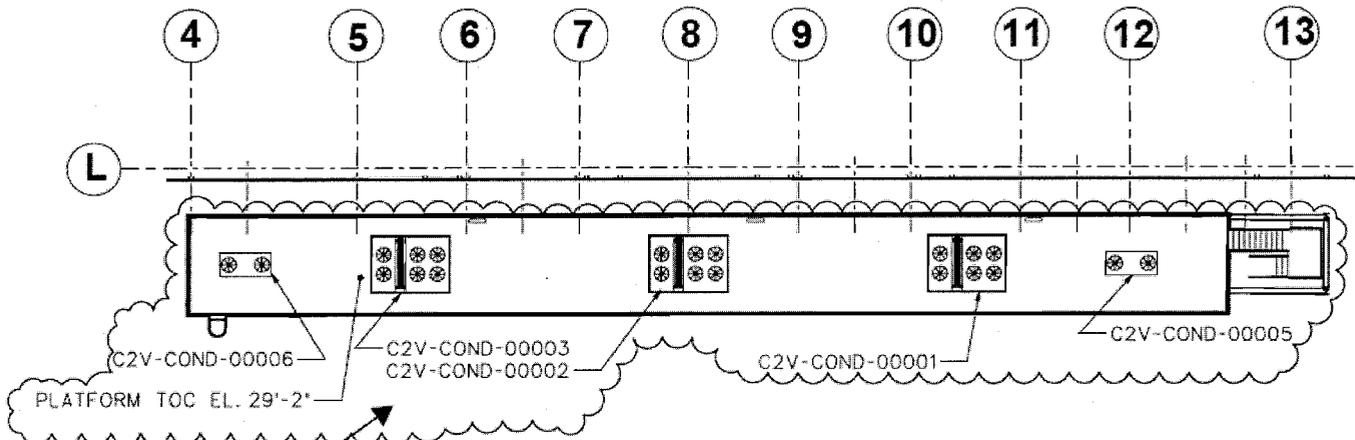

**THIS DCN** →

**REVISED LAYOUT**  
**24590-LAW-P1-P01T-00004 REV. 4**  
**24590-LAW-P1N-P01T-00057**




# Drawing Change Notice

Page 6 of 8

CHANGE DOCUMENT NO.  
24590-LAW-P1N-P01T-00057

JOB NO. 24590	TITLE FOR CHANGE NOTICE REVISION TO LAW UPS BATTERY ROOM LAYOUT
------------------	--

## DESCRIPTION OF CHANGE

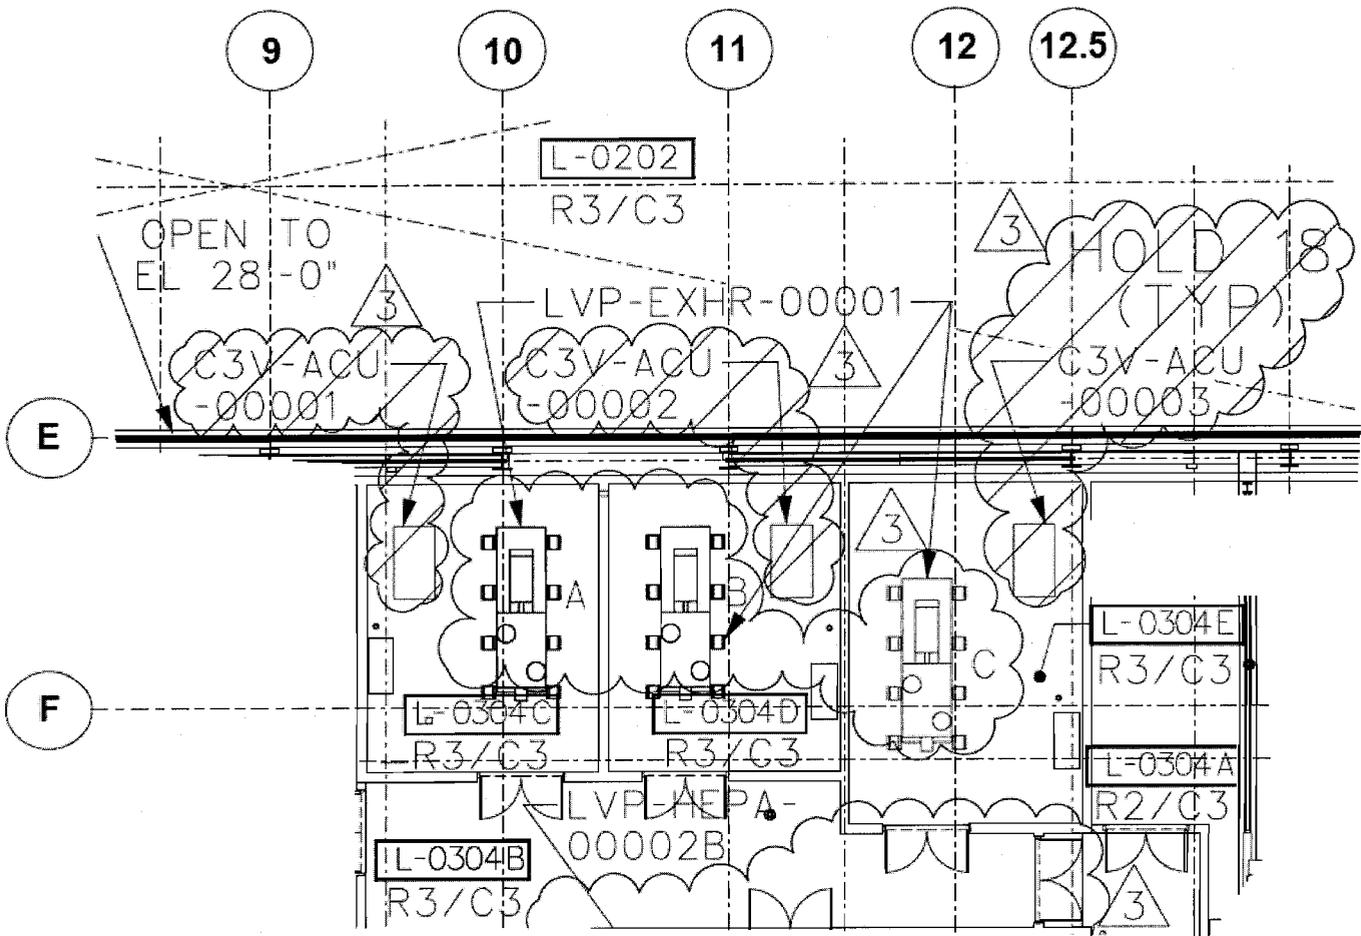

**CURRENT LAYOUT L-0304C/D/E**  
**24590-LAW-P1-P01T-00005 REV. 3**  
**24590-LAW-P1N-P01T-00057**




# Drawing Change Notice

Page 7 of 8

CHANGE DOCUMENT NO.  
24590-LAW-P1N-P01T-00057

JOB NO. 24590	TITLE FOR CHANGE NOTICE REVISION TO LAW UPS BATTERY ROOM LAYOUT
------------------	--

## DESCRIPTION OF CHANGE

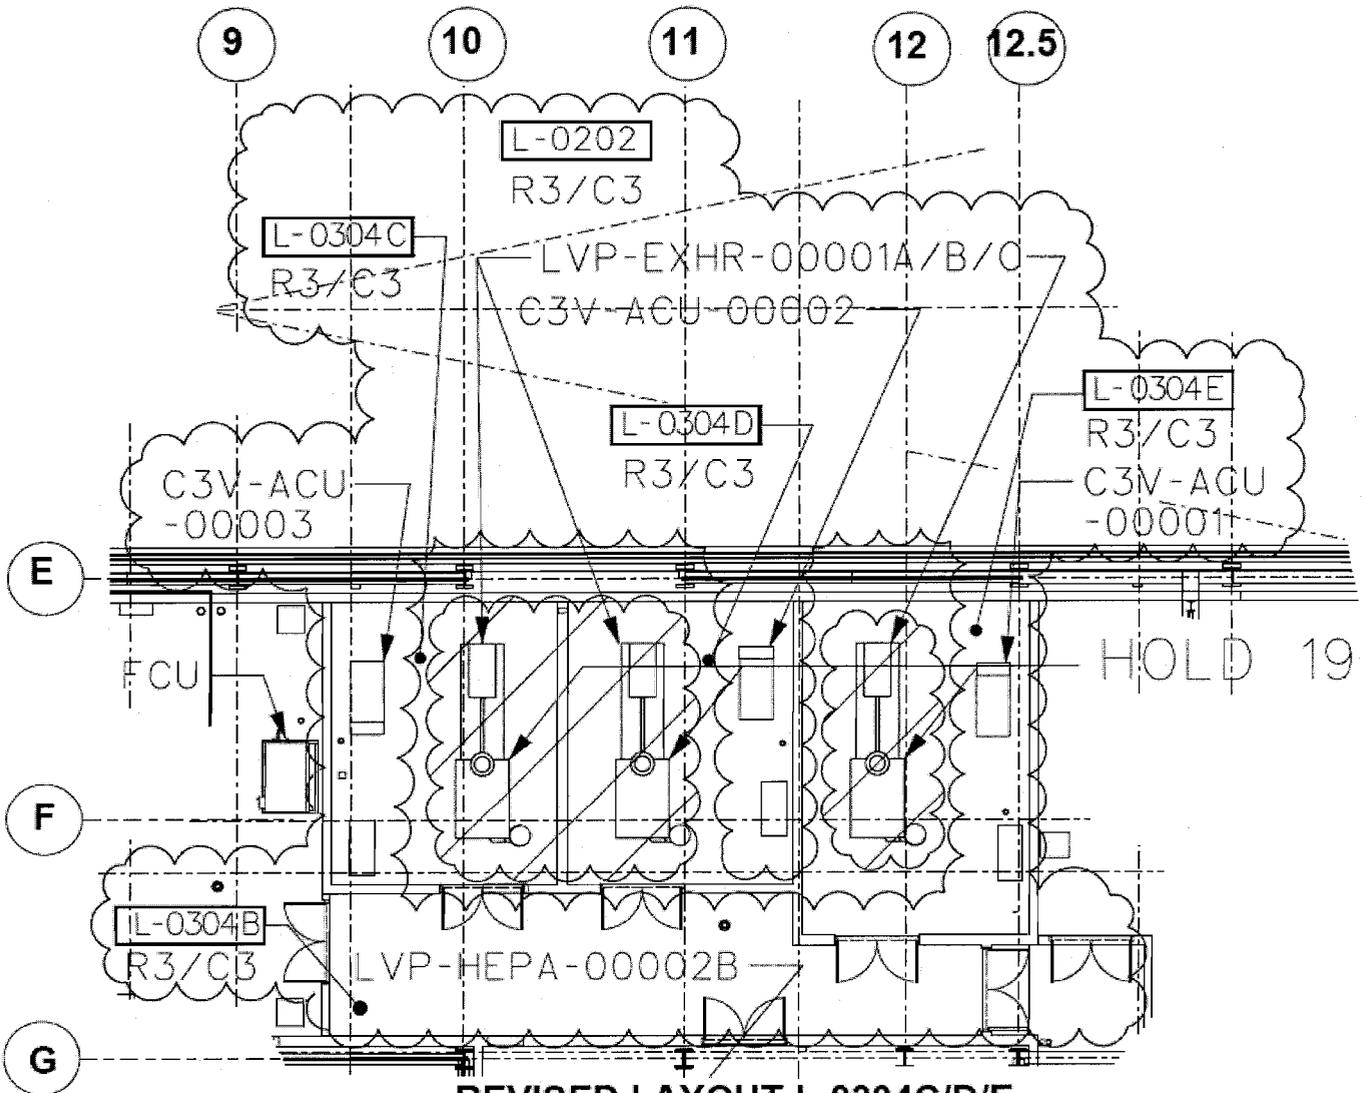

**REVISED LAYOUT L-0304C/D/E**  
**24590-LAW-P1-P01T-00005 REV. 3**  
**24590-LAW-P1N-P01T-00057**



# Drawing Change Notice

Page 8 of 8

CHANGE DOCUMENT  
NO.  
24590-LAW-P1N-P01T-  
00057

JOB NO. 24590	TITLE FOR CHANGE NOTICE REVISION TO LAW UPS BATTERY ROOM LAYOUT
------------------	--

ORIGINATOR CRAIG SALERNO <i>Craig M. Salerno</i>	CHECKER EMMITT PACKER <i>Emmitt Packer</i>
---	---

Reviews			
E&NS - Dwight Krahn <i>Dwight Krahn</i>	PD - KEITH HUBER <i>Keith Huber</i>		

Approval(s)			
APEM-LEL - JOHN SCHNEIDER <i>John F. Shih</i>	PD - JACK CLINTON <i>Jack Clinton</i>		

Date (inserted by final approver): 4/5/10