

1
2
3
4

ADDENDUM F
PREPAREDNESS AND PREVENTION

DRAFT

1
2
3
4

This page intentionally left blank.

DRAFT

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17

ADDENDUM F
PREPAREDNESS AND PREVENTION

Contents

F PREPAREDNESS AND PREVENTION..... F.1

F.1 Preparedness and Prevention Requirements F.1

F.1.1 Equipment Requirements..... F.1

F.1.2 Aisle Space Requirement..... F.2

F.2 Preventive Procedures, Structures, and Equipment F.2

F.2.1 Unloading Operations, Spill Prevention, and Control F.2


F.2.2 Runoff F.2

F.2.3 Water Supplies F.3

F.2.4 Equipment and Power Failure..... F.3

F.2.5 Personnel Exposure..... F.3

F.3 Prevention of Reaction of Ignitable, Reactive, and Incompatible Waste F.4

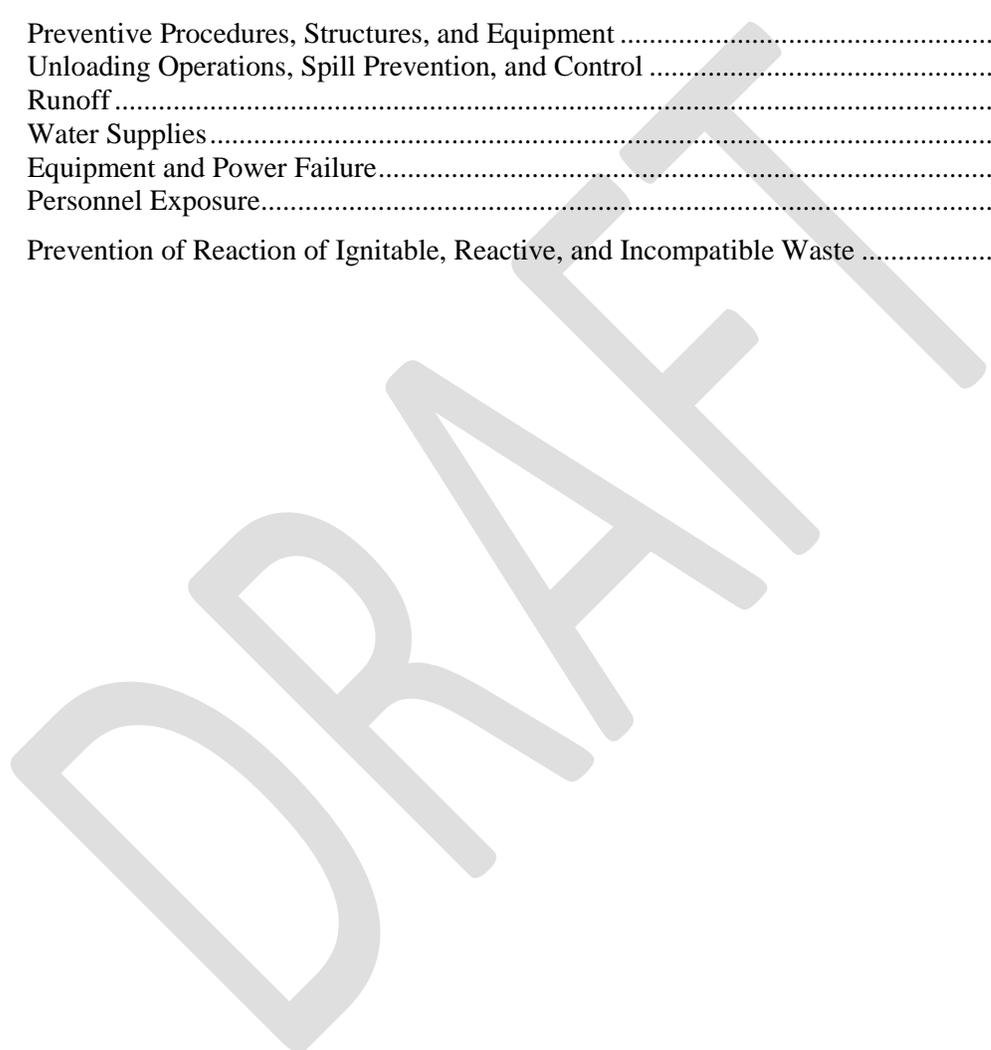

1
2
3
4

This page intentionally left blank.

DRAFT

1 **F PREPAREDNESS AND PREVENTION**

2 **F.1 Preparedness and Prevention Requirements**

3 The following sections document the preparedness and prevention measures taken at LERF and 200 Area
4 ETF.

5 **F.1.1 Equipment Requirements**

6 The following sections describe the internal and external communications systems and the emergency
7 equipment required that could be activated by the LERF and 200 Area ETF Building Emergency Director
8 (BED).

9 **F.1.1.1 Internal Communications**

10 When operators are present at the LERF, the operators carry two-way radios to maintain contact with
11 200 Area ETF personnel. The operators at LERF are informed of emergencies (e.g., building and/or area
12 evacuations, take-cover events, high airborne contamination, fire, and/or explosion), and are provided
13 with emergency instructions by several systems. These systems include the mobile two-way radios, and
14 the telephone in the LERF instrument building.

15 The 200 Area ETF is equipped with an internal communication system to provide immediate emergency
16 instruction to personnel. The onsite communication system at the 200 Area ETF includes telephones,
17 mobile two-way radios, a public address system, and alarm systems. The telephone and radio systems
18 provide for internal and external communication. Alarm systems exist to allow personnel to respond
19 appropriately to various emergencies, including building evacuations, take cover events, and fire and/or
20 explosion. Addendum J provides additional information on the response activities.

21 **F.1.1.2 External Communications**

22 The LERF and its operators are equipped with devices for summoning emergency assistance from the
23 Hanford Fire Department, the Hazardous Materials Response Team, and/or Hanford patrol, as necessary.
24 External communication to summon emergency assistance is made by a normal telephone system or
25 mobile two-way radios. The LERF telephone is available in the instrumentation building. The 200 Area
26 ETF uses fire alarm pull boxes and telephones for external communication which are located at numerous
27 locations throughout the 200 Area ETF.

28 **F.1.1.3 Emergency Equipment**

29 The LERF and 200 Area ETF rely primarily on the Hanford Fire Department to respond to fires and other
30 emergencies as described in Permit Attachment 4, *Hanford Emergency Management Plan*, (DOE/RL-94-
31 02). All LERF and 200 Area ETF operators are familiar with the LERF and 200 Area ETF contingency
32 plans (Addendum J) and are trained in the use of emergency pumping of LERF and 200 Area ETF
33 systems, fire, and communications equipment.

34 Portable fire extinguishers, fire control equipment, spill control equipment, and decontamination
35 equipment is available at various locations in the 200 Area ETF.

36 The 200 Area ETF has fire extinguishers, automatic fire suppression systems (200 Area ETF control room
37 and electrical room), fire alarm pull boxes, and a water spray system (200 Area ETF operating and
38 administrative portions).

39 Respirators, hazardous material protective gear, and special work procedure clothing for 200 Area ETF
40 personnel are kept in the change room at the 200 Area ETF. Safety showers are located in convenient
41 locations in the 200 Area ETF, and emergency eyewashes are available for use. Water for these devices
42 is supplied from the 200 Area ETF sanitary water system.

43 **F.1.1.4 Water for Fire Control**

44 A water main is not provided to the LERF. The Hanford Fire Department is equipped with fire engines
45 for fire control for fires requiring high water volume and pressure. The 200 Area ETF is serviced by two

1 12-inch raw water lines that are tied into the 200 East Area raw water distribution grids. These lines
2 provide a looped configuration that supplies two independent sources of raw water for fire protection and
3 raw water uses. Connections from the 200 Area ETF raw water system supply fire hydrants and the wet
4 pipe sprinkler system. In the event that water pressure is lost, the Hanford Fire Department is equipped
5 with fire engines to provide needed water.

6 **F.1.2 Aisle Space Requirement**

7 The operation of the LERF does not involve aisle space. Nevertheless, the LERF and the individual
8 basins are easily accessible to emergency response personnel and vehicles. A 6.1-meter-wide service
9 road runs along the base of the basin area on the east, south, and west sides within the operational security
10 fence.

11 Aisle spacing at 200 Area ETF is sufficient to allow the movement of personnel and fire protection
12 equipment in and around the containers. This storage arrangement also meets the requirements of the
13 National Fire Protection Association (NFPA 1996) for the protection of personnel and the environment.
14 A minimum 30-inch aisle space is maintained between rows of containers as required by
15 [WAC 173-303-630\(5\)\(c\)](#).

16 **F.2 Preventive Procedures, Structures, and Equipment**

17 The following sections describe preventive procedures, structures, and equipment.

18 **F.2.1 Unloading Operations, Spill Prevention, and Control**

19 Underground pipelines that transfer aqueous waste to and from the LERF are encased in a secondary pipe.
20 If a leak is detected in a pipeline, flow in the pipeline will be stopped and the cause of the leak
21 investigated and remediated.

22 If it is required to transfer aqueous waste from one LERF basin to another, submersible pumps are located
23 in risers at the northwest corner of a basin. Valves are closed or opened depending on the direction of the
24 fluid transfer. Pumps are started, providing a cumulative flow of between 2,000 and 3,000 liters per
25 minute into another basin.

26 The 200 Area ETF Load-in Station is monitored continuously during tank-filling operations and filling is
27 stopped immediately if leaks occur. Care is taken to ensure that even minor leaks are cleaned up
28 immediately and disposed of in accordance with approved management procedures. Any spill that is
29 determined to be a dangerous waste will be managed according to the requirements of [WAC 173-303](#).

30 **F.2.2 Runoff**

31 The LERF is constructed and operated to ensure that all aqueous waste is contained within the basins.
32 The basins are designed and operated to prevent overtopping. Furthermore, the basins are provided with
33 very low-density polyethylene floating covers to prevent the introduction of precipitation into the basins.
34 The basins also are graded to ensure that all precipitation outside the basins is directed away from the
35 surface impoundments.

36 The basins are constructed so that the top of the basin dikes are approximately 3 meters above grade. The
37 exterior side slopes of the basins have a 2.25 (horizontal) to 1 (vertical) slope. Run-on of precipitation to
38 the basins from the surrounding area is not possible because the surrounding area slopes away from the
39 LERF.

40 Dangerous waste and hazardous chemical handling areas at the 200 Area ETF are designed to contain
41 spills, leaks, and wash water, thereby preventing run-off and subsequent releases. All dangerous and/or
42 mixed waste loading and unloading areas are provided with secondary containment structures as
43 described in Addendum C, Process Information.

1 **F.2.3 Water Supplies**

2 The LERF uses operating practices, structures, and equipment to prevent the contamination of natural
3 water supplies (i.e., groundwater and surface water). The LERF is monitored closely during operation to
4 detect abnormal conditions (e.g., leaks), and regularly inspected to detect equipment and structural
5 deteriorations that could allow possible water supply contamination. The basins are provided with a
6 leachate collection system that is designed to contain any leachate generated. These systems, in
7 conjunction with the double-composite liner system and underlying low permeable clay liner, ensure that
8 should a release occur, the release will be fully contained within the basin configuration and, therefore,
9 water supplies will be protected. Addendum J, Contingency Plan, provides information on procedures
10 that are implemented if a release is detected at the LERF.

11 There are no drinking water wells near the 200 Area ETF. Therefore, a release would not immediately
12 contaminate drinking water supplies. The 200 Area ETF uses operating practices, structures, and
13 equipment to prevent the contamination of natural water supplies (i.e., groundwater and surface water).
14 The 200 Area ETF is monitored during operation to detect abnormal conditions, and is inspected regularly
15 to detect equipment and structural deteriorations that could allow spills to the environment. Areas in
16 contact with dangerous and/or mixed waste are monitored continuously during operation through a series
17 of level and pressure indicators, leak detection alarms, equipment failure alarms, and control panel
18 readouts. In addition, the 200 Area ETF is inspected regularly for the presence of leaks or other off
19 normal conditions wherever possible (in all areas that can be safely entered).

20 In addition to detailed operating practices, structures and equipment are used at the 200 Area ETF to
21 prevent contamination of water supplies. The structures and equipment designed to prevent
22 contamination of water supplies are the same as the structures and equipment used to prevent run-off from
23 dangerous and/or mixed waste handling areas.

24 **F.2.4 Equipment and Power Failure**

25 The storage function of the LERF is not affected by loss of power and a temporary loss of power would
26 not pose a threat to the environment. Loss of electrical power would not cause the storage of the waste to
27 be jeopardized. For process condensate transferred from the 242-A Evaporator, appropriate valving
28 procedures are followed to ensure a smooth restart of the flow to the LERF in the event of a power failure
29 at the 242-A Evaporator.

30 The 200 Area ETF does not have a standby power source. Power to selected lighting, computers, and
31 process controls is configured with an uninterruptible power supply. During partial loss of normal power,
32 the effected pumps and subsystems will be shut down. Complete loss of power to the 200 Area ETF
33 shuts down the entire 200 Area ETF except for the instruments in the control room connected to the
34 uninterruptible power supply. Redundant pumps allow the process to continue to operate when only one
35 component is out of service.

36 When power at the 200 Area ETF is lost, the valves assume a fail-safe position to allow the process to
37 remain in a safe shutdown mode until restoration of power. This action allows the operators to perform
38 equipment surveys during shutdown and to confirm that there are no safety issues because the 200 Area
39 ETF is shut down. Because a power failure would also shut off flow into the 200 Area ETF, there will
40 not be any increase in volume in any of the holdup basins, tanks, or other systems.

41 A combination of reliability, redundancy, maintenance, and repair features are used in the 200 Area ETF
42 equipment and systems to minimize random failure of equipment. For crucial systems such as ventilation
43 filters, redundant trains are provided to mitigate equipment and system failure. Spare parts are
44 maintained for essential production and safety equipment.

45 **F.2.5 Personnel Exposure**

46 At the LERF and 200 Area ETF, operating practices, structures, and equipment are used to prevent undue
47 exposure of personnel to dangerous and/or mixed waste. All personnel handling waste use protective

1 clothing and equipment. All operations are conducted so that exposure to dangerous and/or mixed waste
2 and hazardous materials are maintained ALARA.

3 Protective clothing and equipment are prescribed for personnel handling chemicals or dangerous waste.
4 Before the start of any operation that could expose personnel to the risk of injury or illness, a review of
5 the operation is performed to ensure that the nature of hazards that might be encountered is considered
6 and appropriate protective gear is selected. Personnel are instructed to wear personal protective
7 equipment in accordance with training, posting, and instructions.

8 A change trailer at LERF is located between Basins 42 and 43. In addition, the change trailer has an
9 operations office for working with procedures. Exits within the change trailer are clearly marked. A
10 storage building is located within the perimeter fence, northwest of the basins. The LERF storage
11 building also is provided with separate storage areas for clean and contaminated equipment. A
12 decontamination shower and decontamination building is located at the 272-AW Building, approximately
13 1.6 kilometers from the LERF or at the 200 Area ETF.

14 The 200 Area ETF has eyewash stations and safety showers in convenient locations for use by personnel.
15 The following structures and equipment were incorporated into the 200 Area ETF design to minimize
16 personnel exposure.

- 17 • Offices, control room, clean- and soiled-clothes storage areas, change rooms, and the lunchroom are
18 situated to minimize casual exposure of personnel.
- 19 • Building exit pathways are located to provide rapid egress in emergency evacuations.
- 20 • Emergency lighting devices are located strategically throughout the 200 Area ETF.
- 21 • Audio and/or visual alarms are provided for all room air samplers, area alarms, and liquid monitors.
22 Visual readouts for these alarm systems are located in less contaminated areas to minimize exposure
23 to personnel.
- 24 • Areas for decontaminating and maintaining equipment are provided in contaminated areas to limit the
25 spread of contamination to uncontaminated areas such as the control room.
- 26 • Instrument interlock systems automatically return process operations to a safe condition if an unsafe
27 condition should occur.
- 28 • The 200 Area ETF ventilation systems are designed to provide airflow from uncontaminated zones to
29 progressively more contaminated zones.

30 Whenever possible, exposures to hazards are controlled by accepted engineering and/or administrative
31 controls. Protective gear is used where effective engineering or administrative controls are not feasible.

32 **F.3 Prevention of Reaction of Ignitable, Reactive, and Incompatible Waste**

33 Typically, aqueous waste managed at the LERF or 200 Area ETF does not display the characteristics of
34 reactivity or ignitability. Any aqueous waste streams exhibiting these characteristics are blended or
35 mixed at LERF to a concentration where the waste no longer exhibits reactive or ignitable characteristics.

36 Incompatible aqueous waste is not expected to be stored or treated at the LERF or 200 Area ETF
37 (Addendum B, Waste Analysis Plan). Therefore, the requirements of [WAC 173-303-806\(4\)\(a\)](#) are not
38 applicable.

39

1
2
3
4

This page intentionally left blank.

DRAFT