



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

ISSUED BY
RPP-WTP/PDC

R 1125624 1

Project:	RPP-WTP	P&ID:	24590-PTF-M6-HLP-00001001
Project No:	24590	Calculations:	Attachment 1
Project Site:	Hanford	Vessel Drawing:	24590-PTF-MV-HLP-00006, 24590-PTF-MV-HLP-00009, 24590-PTF-MV-HLP-00011
Description:	HLW Lag Storage Vessel	Reports	Attachment 1

Reference Data

Charge Vessels (Tag Numbers)	Deleted
Pulsejet Mixers / Agitators (Tag Numbers)	HLP-PJM-00060, HLP-PJM-00061, HLP-PJM-00062, HLP-PJM-00063, HLP-PJM-00064, HLP-PJM-00065, HLP-PJM-00066, HLP-PJM-00067
RFDs/Pumps (Tag Numbers)	Deleted

Design Data

Quality Level	Q (Note 13)		Fabrication Specs	24590-WTP-3PS-MV00-T0001		
Seismic Category	SC-I		Design Code	ASME VIII Div 1		
Service/Contents	Radioactive Slurry		Code Stamp	Yes		
Design Specific Gravity	1.5		NB Registration	Yes		
Maximum Operating Volume	gal	112,900 (Note 4)	Weights (lbs)	<u>Empty</u>	<u>Operating</u>	<u>Test</u>
Total Volume	gal	127,260 (Note 4)	Estimated	360,000	1,710,000	1,480,000

Inside Diameter	inch	300			Wind Design	Not Required
Length/Height (TL-TL)	inch	354			Snow Design	Not Required
		Vessel Operating	Vessel Design	Coil/Jacket Design	Seismic Design	24590-WTP-3PS-SS90-T0001 24590-WTP-3PS-MV00-T0002
Internal Pressure	psig	0	15	35		
External Pressure	psig	1.5	2.0 (Note 2)	0	Postweld Heat Treat	Not Required
Temperature	°F	140	237	237	Corrosion Allowance	Inch 0.04 (Note 3)
Min. Design Metal Temp.	°F	40				

Materials of Construction

Component	Material	Minimum Thickness / Size	Containment
Top Head	SA 240 316 (Note 7)	See Drawing	Auxiliary (Note 1)
Shell	SA 240 316 (Note 7)	See Drawing	Primary (Note 1)
Bottom Head	SA 240 316 (Note 7)	See Drawing	Primary (Note 1)
Wear Plate	SA 240 316 (Note 7)	See Drawing	N/A
Support	SA 240 304 (Note 7)	See Drawing	N/A
Jacket/Coils/Half-Pipe Jacket	SA 240 316 (Note 7)	See Drawing	N/A
Internals	SA 240 316 (Note 7)	See Drawing	Thermowells Primary (Note 1)
Pipe	SA 312 TP316 Smls (Note 7 and Note 17)	See Drawing	Note 1
Forgings/ Bar stock	SA 182 F316 (Note 7)	See Drawing	Note 1 for Nozzle Necks
Wash Ring Pipe	SA 312 TP316 Smls (Note 7)	See Drawing	N/A
Bolting/ Gaskets	N/A	N/A	N/A
Pulse Jet Mixer Nozzles	Cast Stellite 12, with SA-240-316 (Note 7) Shroud	See Drawing	N/A
Recirculation Nozzles	Cast Stellite 12	See Drawing	N/A
PJM Cluster Fill / PJM Nozzle Fill	Concrete (Note 11)	See Drawing	N/A

Miscellaneous Data

Orientation	Vertical	Support Type	Skirt
Insulation Function	Not Applicable	Insulation Material	Not Applicable
Insulation Thickness (inch)	Not Applicable	Weld Surface Finish	De-scaled as Laid (Note 6)



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

Notes/Remarks

- Note 1:** All welds forming part of the primary and auxiliary containments, including the nozzle attachment welds shall be subjected to 100% volumetric examination.
- Note 2:** External design pressure for shell areas under the jacket shall be rated for the jacket internal design pressure plus 2.0 PSIG (negative) vessel external design pressure to account for ventilation fan pressures. 
- Note 3:** - Corrosion allowance for jacket shall be 0.04 inch.
-  - Vessel bottom head - additional erosion allowance from reference 24590-WTP-MOE-50-00014 Attachment 10-11 provides a vessel erosion allowance of 0.768" (max) for HLP-VSL-000027A/B. This erosion allowance is accounted for via the 1" thick wear plates installed in the vessel bottom head directly under the PJM outlet nozzle.
-  - PJM additional erosion allowance from reference 24590-WTP-MOC-50-00004 Rev E, Table 10-5, provides an erosion allowance of 0.093" (HLP-27A/B) for the stellite 12 material used in the PJM cones. The minimum thickness requirement for the PJM stellite cone material is 0.4375".
- Note 4:** Vessel volumes are approximate and do not account for manufacturing tolerances, nozzles, and displacement of all internals, supports and cluster. 
- Note 5:** Contents of this document are Dangerous Waste Permit affecting.
- Note 6:** Grind smooth shell welds at shell-jacket welds.
- Note 7:** Maximum carbon content of 0.030% for all welded components.
- Note 8:** Deleted. 
- Note 9:** This vessel is located in a Black Cell.
- Note 10:** Deleted per report NO. 24590-WTP-RPT-M-04-00007 dated Nov. 01, 2004
- Note 11:**  (a) The intent is to provide a concrete mix with low chlorides, low moisture, low porosity and inhibits corrosion. The concrete formulation and blending should follow the relevant paragraphs in ASTM C 94 Option B. The Portland cement should be Type I/II conforming to ASTM C 150. Coarse aggregates shall be no larger than 3/4" diameter. The coarse and fine aggregates should be tested for chloride content using ASTM C 1152 and requiring less than 0.01% (100 ppm) acid-soluble chloride, and by limiting the water chloride content to less than 200 ppm. The concrete mix shall include chemical admixtures, follow ASTM C494 for control over admixtures. A final report, see ASTM C494 Section 19, shall be submitted, the report is required to have a precision statement.
- Additional WTP requirements:**
- Do not use blast furnace slag in the concrete.
 - To reduce the permeability, the water-to-cement ratio shall be low, lower than 0.40%, using a Type F admixture in quantities that have no adverse effects on fresh and hardened properties.
 - To reduce the corrosion, an admixture shall be used, calcium nitrate is to be added at a concentration no more than 32 lb/yd³.
 - Use Type F fly ash and silica fume, to reduce porosity, add in quantities to minimize porosity with no adverse effects on fresh and hardened properties.
- The concrete is to fill the entire cluster volume up to the bottom of the fill nozzle. Concrete shall be poured in a manner that allows for the even distribution of aggregate and mechanically vibrated to assure no major pockets or voids. Concrete is to be poured through more than one nozzle, in lifts. The seam between lifts is not important.
- Because of the unique geometry and inability to rework or repair the concrete, assurance that the fill is complete and 100% filled via in-process observance, boroscope or other methods. Fill report shall be provided.
 - Curing: The concrete shall be thoroughly cured (at least 30 days) before the shroud is closed.
 - The seller shall submit mix design and complete procedure for concreting for buyer's approval.
 - The concrete fill can be purchased commercial
-  (b). Fill gap completely between PJM shroud and stellite nozzles with Aremco 646-N Ceramcast (or equal), see CCN 156345 for procedure.
- Note 12:** Deleted. 
- Note 13:** Vessel to be designed, fabricated, tested to L-1 and black cell requirements defined in 24590-WTP-3PS-MV00-T0001. 



MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

NOTES / REMARKS CONTINUED:

Note 14: Clarification to quality level, revised specific gravity, operating external pressure, revised vessel external design pressure, revised jacket external design pressure, revised operating temperature, added Data Reference, revised Note 2, added Note 13 and Note 14, added functional/safety requirements, added Seismic section, change to parent vessel cyclic data, change to hydrodynamic loads for normal operations, Increased cycles for PJM single overblow, change to PJM cyclic data, added E&NS table and signature, added section for "Hydrodynamic Loads -Pulse Jet Mixers", added section for "Multiple Overblow Loading - PJMs", added section for HPAV Load Conditions. Added Section for Nozzle Loads, included environmental qualification data, added DOE disclaimer. If any Sections contain a revision triangle  next to the Section heading means the entire section has been revised or is new - the entire section must be reviewed for changes/additions.

Note 15: Per CCN 193847, replaced ISRS curves with WSGM curves which provide for a lower acceleration value. Removed HPAV loads and Functional/Safety Requirements. Revised entire Equipment Qualification Sections. Revise PJM Overblow Loads and added Cluster Overblow Loads. Renumbered Equipment Qualification Notes and numbered/revised Nozzle Load Notes. 



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

Hydrodynamic Loading - Pulse Jet Mixers (PJMs)



Pulse Jet Mixers (PJMs) are designed to mix the vessel content using a liquid jet discharge. PJM's are driven by compressed air. The mixing is required to enhance the heat transfer from the fluid to the cooling jackets, to homogenize the solution and to release hydrogen from the fluid.

The PJMs operate in the following three cycles: Suction, Drive and Vent. During the suction cycle a vacuum is created in the PJM headspace and the level within the PJM rises to fill the PJM. During the drive cycle the PJM is pressurized and liquid is discharged. During the vent cycle, the pressure in the headspace approaches atmospheric and the level within the PJM is allowed to reach equilibrium.

Vessel components shall be designed to withstand loading induced by PJM operations as described here-in.

Normal Operations : *Liquid flows around internal structures within the parent vessel producing hydrodynamic loads such as drag and vortex shedding. Reference the section below for "Normal Operating" loads and "Vortex Shedding" frequencies.*

Overblow Condition: *Occasionally the drive cycle lasts too long and compressed air is discharged from the PJM. Overblows can also occur during system calibration. One or more multiple PJM's may overblow at any time. These conditions induce acoustic and bubble rise loads on structures and components. Overblow loading conditions are provided in the tables and charts below.*

All internal components shall be designed for the combination of normal operations hydrodynamic loads and overblow loads. Single overblows (SOB) act concurrently with the seismic event and other operational loads. Multiple Overblows (MOB) do not act concurrently with the seismic event but are combined with other operational loadings. Figures 1, 2, and 3 below in the "PJM Overblow Loads" section provides the acoustic load intensity and application that encompasses both SOB and MOB.

Normal Operations Loading - PJMs

Description	<p><i>Pulse jet mixers (PJM) impose a cyclical hydrodynamic load on all internal components. The components shall be designed and supported against these hydrodynamic loads due to normal operations. The following table indicates the hydrodynamic pressure for normal conditions at ranges of elevations in the vessel and the number of design cycles for this condition. The hydrodynamic forces cycle between the indicated pressure ranges applied across the projected area of the component. Positive hydrodynamic forces act in the radial, outward direction and the vertical, upward direction. Seller shall apply the radial load simultaneously in the radial direction and normal to the radial direction in the horizontal plane. This load combination acts concurrently with seismic loads for normal PJM operations.</i></p>																															
	<p align="center">Condition</p> <table border="1"> <thead> <tr> <th colspan="6">Hydrodynamic Pressure Range, psi</th> <th rowspan="3">Number of Cycles</th> </tr> <tr> <th colspan="2">Elevation A</th> <th colspan="2">Elevation B</th> <th colspan="2">Elevation C</th> </tr> <tr> <th>Radial</th> <th>Vertical</th> <th>Radial</th> <th>Vertical</th> <th>Radial</th> <th>Vertical</th> </tr> </thead> <tbody> <tr> <td>Normal Operation</td> <td>-0.030 to 0.020</td> <td>-0.030 to 0.020</td> <td>-0.030 to 0.020</td> <td>-0.030 to 0.020</td> <td>-0.025 to 0.057</td> <td>-0.028 to 0.032</td> <td>3.7E6</td> </tr> </tbody> </table>							Hydrodynamic Pressure Range, psi						Number of Cycles	Elevation A		Elevation B		Elevation C		Radial	Vertical	Radial	Vertical	Radial	Vertical	Normal Operation	-0.030 to 0.020	-0.030 to 0.020	-0.030 to 0.020	-0.030 to 0.020	-0.025 to 0.057
Hydrodynamic Pressure Range, psi						Number of Cycles																										
Elevation A		Elevation B		Elevation C																												
Radial	Vertical	Radial	Vertical	Radial	Vertical																											
Normal Operation	-0.030 to 0.020	-0.030 to 0.020	-0.030 to 0.020	-0.030 to 0.020	-0.025 to 0.057	-0.028 to 0.032	3.7E6																									

Vortex Shedding

To mitigate the dynamic effects, the following pipe sizes dipped internal to the vessel are required to have a minimum first natural frequency that is double the vortex shedding frequency:

Nominal Pipe Size	Minimum First Natural Frequency
1 inch nominal	4.8 Hz*
2 inch nominal	2.6 Hz*
3 inch nominal	1.0 Hz**

* See 24590-WTP-MVC-50-00006, Section 8.2.2
** By extrapolation from 1 inch and 2 inch



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

PJM Overblow Loads 8

Discussion: During normal operation, pulse jet mixers (PJM)s mix the fluid by pulling in (suction) and pushing out (drive) fluid. During an upset condition, designated as an 'overblow', air is discharged following the drive cycle of one or more PJMs. The load consists of acoustic pressure (2Hz to 200Hz) developed in the first 200ms of the event and a load due to the bubble rising through the fluid.

The acoustic load and the bubble load are design loads as defined by ASME B&PVC, Section 8, Division 1, UG-22, applied statically. The acoustic load is not added to the bubble rise load because they occur at different times during the overblow event.

Acoustic Load

- The acoustic design load in Figure 1 is applied to the visible (as viewed from the overblow origin) surface of cylindrical targets such as pipes, charge vessels, and PJMs. The load is applied in the direction normal to the principal axis of the target as illustrated in Figure 2. Note: The intended net effective load on the target is equal to the projected (i.e. cross-sectional) area of the object times the acoustic design load (psi) indicated in Figure 1.
- Each target is considered independent of the surrounding targets: e.g. the surrounding targets do not impede the acoustic wave by casting a shadow, as illustrated in Figure 2.
- The load is not applied to small supports such as gussets, brackets, tabs, clamps, and bolts because they are rigid and the pressure drop across the target is negligible.
- When the vessel contains multiple PJMs, the load from one PJM is independent of the load from other PJMs. The loads are not additive for multiple overblows.
- No internal components shall be placed within 5 PJM nozzle diameters ($5 \times 4 \text{ in} = 20 \text{ in}$) of a spherical zone centered at any overblowing PJM nozzle.

Figure 1: Acoustic Design Load


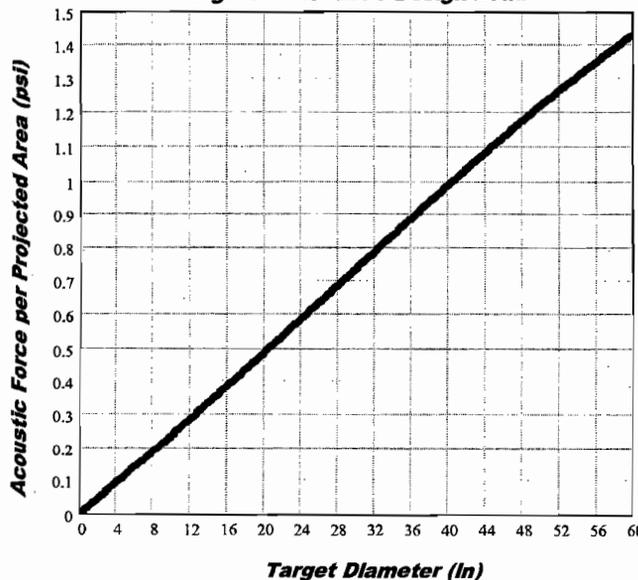


Figure 2: Load Application

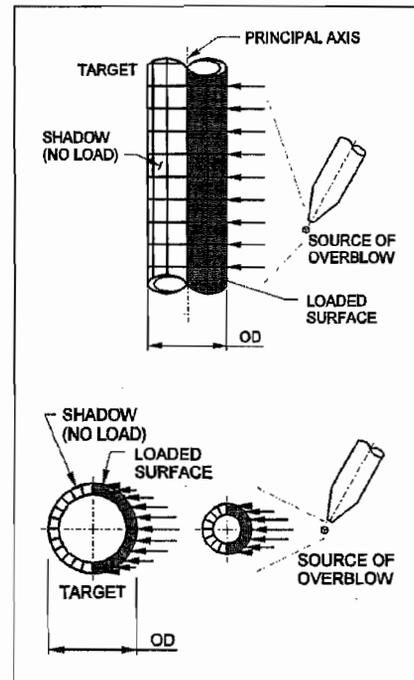

The following data is required to determine the load:

- Target Diameter
- Target Principal Axis
- Overblow Source Coordinates

Number of Acoustic Cycles	1000 events X 40 cycles/event for a total of 40,000 cycles
Bubble Rise Load	A vertical force per projected area of 1.7 psi is applied to the surfaces in the 36-inch diameter cylindrical zone centered at the overblowing PJM(s). The bubble can be at any elevation above the overblowing PJM and only affects one zone (36-inch diameter region) at a time. When there are multiple PJMs in a vessel (MOB), each PJM has it's own bubble. To simplify analysis the bubble can be applied in a continuous cylindrical zone above each PJM.
Number Bubble Rise Cycles	1000 events X 1 cycle/event for a total of 1,000 cycles



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

PJM Cluster Overblow Load


Discussion: The acoustic design pressure on the PJM cluster is determined from equation 5-8 in 24590-WTP-MVC-50-00011, Rev B. The worst-case orientation of the load needs to be determined by the user.

Acoustic Load

The following is the load magnitude for the PJM Cluster in HLP-VSL-00027A/B/28 with an outer radius of 89.5 inches measured to the outer most radil of the cluster. Follow the steps described below:

- 1. Isolate the PJM Cluster and supports from parent vessel**
- 2. Run a modal analysis and determine the first frequency**
- 3. Use Figure 3 (below) to find the acoustic force per projected area**
- 4. Apply the static load in the same orientation as indicated in Figure 2 (above)**

Figure 3: Acoustic Design Pressure on Cluster

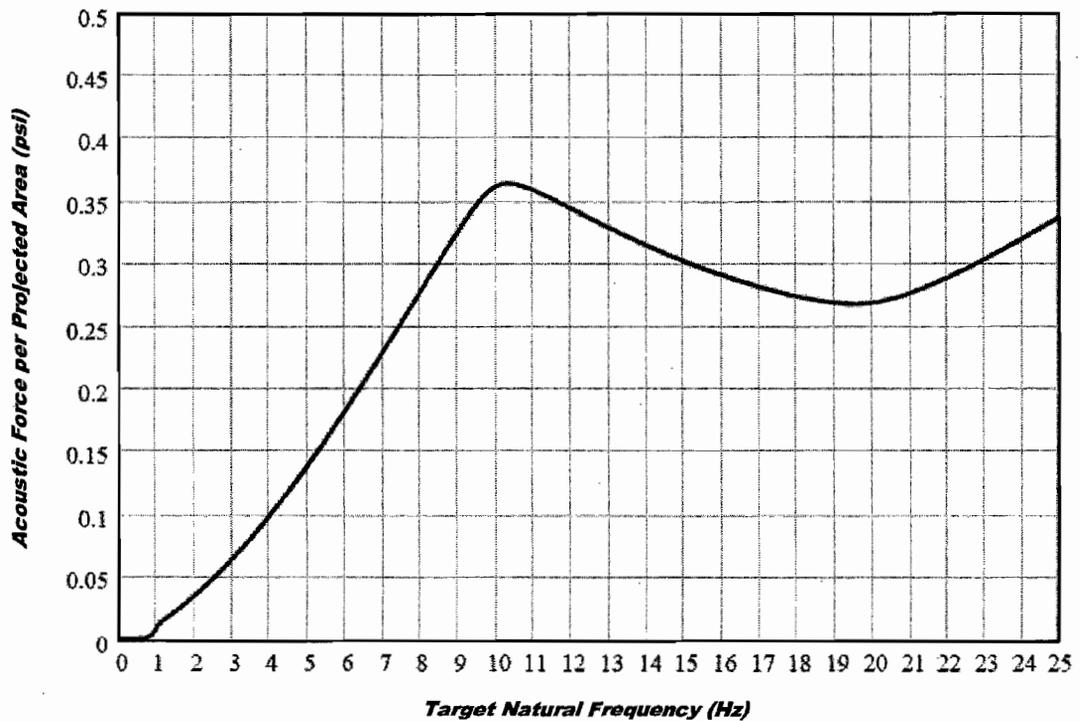

Number of
Acoustic
Cycles

1000 events X 40 cycles/event, 40,000 cycles total



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

Equipment Cyclic Data Sheet-Parent Vessel

Plant Item Number	24590-PTF-MV-HLP-VSL-00027A
Component Description	Parent Vessel

The information below is provisional and envelopes operational duty for fatigue assessment. It is not to be used as operational data.

Materials of Construction	SA 240 316 with maximum carbon of 0.030 %				
Design Life	40 years				
Component Function and Life Cycle Description	This vessel is filled over a period of 22 days, resulting in 660 cycles over a 40 year life. Contents transferred as a batch to HLP-VSL-00028 (i.e., could be drained in one day). The vessel is drained and the internals are washed yearly. The temperature is maintained normally at or below 140°F.				
Load Type	Min	Max	Number of Cycles	Comment	
Design Pressure	psig	-8	15	10	Nominal assumption for testing
Operating Pressure	psig	-1.5	0	7.0E6	Maximum Operating Loss of Power
Operating Temperature	°F	-1.5	2.8	40	
		59	140	660	Uniform material temperature range, not between two points. Temperature cycling is not required by design.
Contents Specific Gravity		1.00	1.5	660	Nominal assumption. Coincident with contents level cycles
Contents Level	inch	38	389	660	Contents level measured from center of bottom head
Localized Features					
Nozzles			As above		
Cooling Jacket			Cooling Water inlet temperature is 50° F (max)		

Notes

- **Cycle increase:** The Seller must increase the numbers of operational cycles given above by 10% to account for commissioning duty unless otherwise noted.

Equipment Cyclic Data Sheet-Pulse Jet Mixers

Component Plant Item Number	HLP-PJM-00060, HLP-PJM-00061, HLP-PJM-00062, HLP-PJM-00063, HLP-PJM-00064, HLP-PJM-00065, HLP-PJM-00066, HLP-PJM-00067
Component Description	Pulse Jet Mixers

The information below is provisional and envelopes operational duty for fatigue assessment. It is not to be used as operational data.

Materials of Construction	SA 240 316 with maximum carbon of 0.030 %				
Design Life	40 Years				
Component Function and Life Cycle Description	These pulse jet mixers (PJMs) are cyclically loaded using vacuum to fully fill the PJM with process liquid and compressed air to empty the PJM. The PJMs are contained within a parent vessel with varying liquid level. They shall be designed to cycle between the maximum design pressure and the minimum design pressure plus the external static head imposed by the parent vessel. The PJM supports shall be designed to cycle between fully buoyant (PJM empty and parent vessel full) and fully loaded (PJM full and parent vessel empty) states. Thrust load shall be applied only to the fully buoyant state. Assume the parent vessel is full for 50% of the number of PJM cycles.				
Load Type	Min	Max	Number of Cycles	Comment	
Design Pressure	psig	FV	80	100	Nominal assumption
Operating Pressure	psig	FV	50	3.7E6	Pressure cycles to be at 140° F and non-coincident with temperature cycles
Operating Temperature	°F	59	140	660	Parent vessel will be operated normally at or below 140°F
Contents Specific Gravity		1.0	1.5	660	
Contents Level	inch	Empty	Flooded	3.7E6	
Thrust	lbf	-394	394	3.7E6	
Localized Features					
Supports	buoyant to loaded		3.7E6		

Notes

- **Cycle increase:** The Seller must increase the numbers of operational cycles given above by 10% to account for commissioning duty unless otherwise noted.



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

Nozzle Loads \triangle

Nozzle	Size	Load Type	Loads - lbs			Moments - ft-lbs		
			Fx	Fy	Fz	Mx	My	Mz
N01	24"	Weight	Manway (No loads applied)					
		Seismic						
		Thermal						
N02	8"	Weight	234	543	234	741	464	1065
		Seismic	3539	2429	2980	5159	9728	15468
		Thermal	893	1152	1193	5268	7193	10243
N04	4" Spare	Weight	87	140	87	216	135	135
		Seismic	480	320	480	1537	2310	2310
		Thermal	295	263	393	945	1890	1890
N05	10"	Weight	264	421	264	1410	885	885
		Seismic	1432	956	1432	9634	14438	14438
		Thermal	1187	848	1268	6375	12750	12750
N06	6"	Weight	N06 is parent nozzle, nozzle loads are applied via N06A, N06B, N06C					
		Seismic						
		Thermal						
N06A (Note C)	1"	Weight	15	20	15	20	20	20
		Seismic	53	35	53	65	96	96
		Thermal	30	26	40	38	77	77
N06B (Note C)	1"	Weight	15	20	15	20	20	20
		Seismic	53	35	53	65	96	96
		Thermal	30	26	40	38	77	77
N06C (Note C)	1"	Weight	15	20	15	20	20	20
		Seismic	53	35	53	65	96	96
		Thermal	30	26	40	38	77	77
N07	2 x 1"	Weight	15	20	15	20	20	20
		Seismic	53	35	53	65	96	96
		Thermal	30	29	40	38	77	77
N08	6"	Weight	N08 is parent nozzle, nozzle loads are applied via N08A, N08B, N08C					
		Seismic						
		Thermal						
N08A (Note C)	1"	Weight	15	20	15	20	20	20
		Seismic	53	35	53	67	96	102
		Thermal	30	26	40	38	77	77
N08B (Note C)	1"	Weight	15	20	15	20	20	20
		Seismic	53	35	53	95	96	124
		Thermal	30	26	40	38	77	77
N08C (Note C)	1"	Weight	15	20	15	20	20	20
		Seismic	53	35	53	74	96	96
		Thermal	30	26	40	38	77	77
N09	6"	Weight	N09 is parent nozzle, nozzle loads are applied via N09A, N09B, N09C					
		Seismic						
		Thermal						
N09A (Note C)	1"	Weight	15	20	15	20	20	20
		Seismic	53	35	53	65	96	96
		Thermal	30	26	40	38	77	77



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

Nozzle	Size	Load Type	Loads - lbs			Moments - ft-lbs		
			Fx	Fy	Fz	Mx	My	Mz
N09B (Note C)	1"	Weight	15	20	15	20	20	20
		Seismic	53	35	53	65	96	96
		Thermal	30	28	40	39	77	77
N09C (Note C)	1"	Weight	15	20	15	20	20	20
		Seismic	53	35	53	65	96	96
		Thermal	30	26	40	41	77	77
N10	2"	Weight	50	128	50	75	75	90
		Seismic	186	278	186	277	415	614
		Thermal	114	100	152	169	337	337
N11	2"	Weight	50	69	50	75	75	75
		Seismic	222	270	186	317	415	415
		Thermal	114	100	152	169	337	337
N12	2"	Weight	50	120	50	75	75	75
		Seismic	186	287	186	488	415	564
		Thermal	114	100	152	169	337	337
N13	2"	Weight	50	104	50	75	75	75
		Seismic	186	656	186	627	415	415
		Thermal	114	100	152	169	337	337
N14	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	119	152	176	337	337
N15	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N16	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N17	2"	Weight	50	98	50	75	75	75
		Seismic	186	170	186	277	415	415
		Thermal	114	100	152	169	337	337
N18	2"	Weight	50	81	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N19	2"	Weight	50	69	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	214	337	337
N20	2"	Weight	50	77	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N21	2"	Weight	50	65	50	75	75	75
		Seismic	186	123	186	361	415	415
		Thermal	114	100	152	169	337	337
N25	2" Spare	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

Nozzle	Size	Load Type	Loads - lbs			Moments - ft-lbs		
			Fx	Fy	Fz	Mx	My	Mz
N27	3"	Weight	52	95	52	119	75	75
		Seismic	401	189	284	819	1227	1227
		Thermal	186	273	229	498	998	998
N28	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N29	2"	Weight	50	81	50	75	75	75
		Seismic	520	240	186	263	131	1225
		Thermal	114	100	152	75	75	75
N30	3"	Weight	52	175	52	119	75	303
		Seismic	726	511	408	263	263	700
		Thermal	171	153	229	100	100	100
N31	3"	Weight	52	84	52	119	75	75
		Seismic	284	189	284	819	1227	1227
		Thermal	171	153	229	498	998	998
N32	4"	Weight	87	167	87	216	135	501
		Seismic	480	320	480	1537	2310	2310
		Thermal	315	263	393	945	1890	1890
N33	3"	Weight	52	156	52	119	75	128
		Seismic	1178	530	376	438	350	1400
		Thermal	171	153	229	100	100	100
N34	3"	Weight	52	146	52	119	75	141
		Seismic	504	404	301	700	1050	1663
		Thermal	171	153	229	100	100	100
N35	4"	Weight	87	140	102	258	548	207
		Seismic	480	320	480	1537	2310	2310
		Thermal	351	263	393	945	1890	1890
N36	4"	Weight	87	180	87	216	135	260
		Seismic	480	320	480	1537	2310	2310
		Thermal	295	263	393	945	1890	1890
N37	3"	Weight	52	129	52	124	75	75
		Seismic	347	226	840	1225	1488	963
		Thermal	171	153	383	500	100	100
N39	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N40	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N41	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N42	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

**PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A**

Nozzle	Size	Load Type	Loads - lbs			Moments - ft-lbs		
			Fx	Fy	Fz	Mx	My	Mz
N43	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N44	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N45	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N46	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N47	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N48	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N49	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N50	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N51	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N52	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N53	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N54	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N55	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N56	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N57	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

Nozzle	Size	Load Type	Loads - lbs			Moments - ft-lbs		
			Fx	Fy	Fz	Mx	My	Mz
N58	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N59	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N60	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N61	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N62	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N63	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N64	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N65	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N66	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N67	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N68	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N69	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N70	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N71	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N72	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337



**MECHANICAL DATA SHEET: VESSEL
EQUIPMENT QUALIFICATION**

PLANT ITEM No.
24590-PTF-MV-HLP-VSL-00027A

Nozzle	Size	Load Type	Loads - lbs			Moments - ft-lbs		
			Fx	Fy	Fz	Mx	My	Mz
N73	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N74	2"	Weight	50	60	50	75	75	75
		Seismic	186	123	186	277	415	415
		Thermal	114	100	152	169	337	337
N76	8"	Weight	475	475	475	475	475	475
		Seismic	1313	1313	1313	1313	1313	1313
		Thermal	600	600	600	600	600	600
N77	8"	Weight	475	475	475	475	475	475
		Seismic	1313	1313	1313	1313	1313	1313
		Thermal	600	600	600	600	600	600

Notes for Nozzle Loads

- A. Direction of load application is per diagrams in 24590-WTP-3PS-MV00-T0001 Appendix A.
- B. For nozzles in head: x = North/South, y = Vertical, and z = East/West - Vessel 0° defined as north.
- C. Values provided at plate on top of parent nozzle. Loads for 6" instrument nozzles are summed from 1" - A, B and C loads.
- D. Nozzle loads shown are to be used in place of those specified in 24590-WTP-3PS-MV00-T0001 – do not apply any thermal reduction factors.
- E. All Pretreatment RGM Seismic Piping Nozzle loads from Plant Design have a 1.75 load factor applied to all seismic loads to address coupling effects between the flexible vessels and piping in accordance with the Seismic Classification and Evaluation for the Pretreatment Facility Piping and Vessels 24590-WTP-RPT-ENG-09-040. (BNI use only, see CCN 229865 for nozzle load management).



EQUIPMENT QUALIFICATION DATASHEET (EQD)

24590-PTF-MVD-HLP-00007
Rev.: 8

Page 14 of 17

Equipment Identification			
Component Tag Number	24590-PTF-MV-HLP-VSL-00027A	Safety Classification	<input checked="" type="checkbox"/> SC <input type="checkbox"/> SS <input type="checkbox"/> APC <input type="checkbox"/> SDC <input type="checkbox"/> SDS <input type="checkbox"/> RRC
Manufacturer / Supplier	Harris Thermal		
Requisition Number	24590-QL-MRB-MVA0-00001		
Model	Custom	Seismic Category	<input checked="" type="checkbox"/> SC-I <input type="checkbox"/> SC-II <input type="checkbox"/> SC-III <input type="checkbox"/> SC-IV
Description (Include descriptive text [e.g., location, elevation])	HLW Lag Storage Vessel. Elevation 0'-0", Column Lines K and 24.		
Safety Function(s)	HLP-VSL-00027A (parent vessel) is considered a high active process vessel credited to prevent spills of large quantities of high activity process liquid and provide primary confinement for radioactive releases. Pulse Jet Mixers (PJMs) provide a mixing function in the vessel to prevent hydrogen accumulation. Air sparger piping provides air to mix solids and dilute hydrogen to prevent hydrogen accumulation. Vessel level instrumentation, provides level monitoring to prevent overflows of non-Newtonian fluids into Newtonian overflow vessels and ensure proper headspace volumes are maintained for hydrogen dilution. 24590-WTP-PSAR-ESH-01-002-02 Rev 4q, Section 4.3.4, 4.3.5, and Table 4A-1 ⚠		
Seismic Safety Function	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Room Number(s): P-0102	
Maintenance Accessible	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Method of Maintenance Access: <input type="checkbox"/> Remote <input type="checkbox"/> Hands On <input checked="" type="checkbox"/> None	
Seismic Operability Requirements:	<input checked="" type="checkbox"/> During Seismic Event <input checked="" type="checkbox"/> After Seismic Event		
ITS Equipment Type:	<input checked="" type="checkbox"/> Passive Mechanical <input type="checkbox"/> Active Mechanical <input type="checkbox"/> Electrical		

Equipment Environmental Qualification (EEQ)					
Environment	<input checked="" type="checkbox"/> Mild <input type="checkbox"/> Harsh		Hi Rad Service	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Contamination Class:	C5		Design Life (yrs)	<input checked="" type="checkbox"/> 40 <input type="checkbox"/> Other _____	
Radiation Class:	R5				
Parameter Type/Units	Parameter Value	Time Duration (number)	Time Units	WTP Document Number (BUYER)	Submittal Number (SELLER)
Normal					
Normal High Temperature (°F)	113	40	yrs	24590-PTF-U0D-W16T-00001	E-Note 1
Normal Low Temperature (°F)	59	40	yrs	24590-PTF-U0D-W16T-00001	E-Note 1
Normal High Relative Humidity (%RH)	90	40	yrs	24590-PTF-U0D-W16T-00001	E-Note 1
Normal Low Relative Humidity (%RH)	5	40	yrs	24590-PTF-U0D-W16T-00001	E-Note 1
Normal High Pressure (in.-w.g.)	0 (E-Note 2)	40	yrs	24590-PTF-U0D-W16T-00001	E-Note 1
Normal Low Pressure (in.-w.g.)	(-) 1.4	40	yrs	24590-PTF-U0D-W16T-00001	E-Note 1
Normal Radiation Dose Rate (mR/hr)	991000 (E-Note 2)	40 (E-Note 5)	yrs	24590-PTF-U0D-W16T-00001	E-Note 1
Vibration Magnitude (g)	N/A	N/A	N/A	N/A	N/A
Vibration Frequency (Hz)	N/A	N/A	N/A	N/A	N/A
Additional Normal Information:	N/A				



EQUIPMENT QUALIFICATION DATASHEET (EQD)

24590-PTF-MVD-HLP-00007
Rev.: 8

Page 15 of 17

Equipment Environmental Qualification (EEQ) (continued)

Parameter Type/Units	Parameter Value	Time Duration (number)	Time units	WTP Document Number (BUYER)	Submittal Number (SELLER)
Abnormal					
Abnormal High Temperature (°F)	115	8	hrs/yr	24590-PTF-U0D-W16T-00001	E-Note 1
Abnormal Low Temperature (°F)	40	8	hrs/yr	24590-PTF-U0D-W16T-00001	E-Note 1
Abnormal High Relative Humidity (%RH)	100c	1	hrs/yr	24590-PTF-U0D-W16T-00001	E-Note 1
Abnormal Low Relative Humidity (%RH)	10	24	hrs/yr	24590-PTF-U0D-W16T-00001	E-Note 1
Abnormal High Pressure (in.-w.g.)	4 (E-Note 2)	8	hrs/yr	24590-PTF-U0D-W16T-00001	E-Note 1
Abnormal Low Pressure (in.-w.g.)	(-) 7.3 (E-Note 2)	8	hrs/yr	24590-PTF-U0D-W16T-00001	E-Note 1
Abnormal Radiation Dose Rate (mR/hr)	991000 (E-Note 4)	0 (E-Note 5)	yrs	24590-PTF-U0D-W16T-00001	E-Note 1
Wet Sprinkler System Present	No	N/A	N/A	24590-PTF-U0D-W16T-00001	E-Note 1
Additional Abnormal Information	100c = 100% RH condensing				
Design Basis Events (DBE)					
DBE High Temperature (°F)	135	1000	hrs	24590-PTF-U0D-W16T-00001	E-Note 1
DBE Low Temperature (°F)	40	1000	hrs	24590-PTF-U0D-W16T-00001	E-Note 1
DBE High Relative Humidity (%RH)	100c	40	hrs	24590-PTF-U0D-W16T-00001	E-Note 1
DBE Low Relative Humidity (%RH)	6	1000	hrs	24590-PTF-U0D-W16T-00001	E-Note 1
DBE High Pressure (in.-w.g.)	4 (E-Note 2)	1000	hrs	24590-PTF-U0D-W16T-00001	E-Note 1
DBE Low Pressure (in.-w.g.)	(-) 7.3 (E-Note 2)	1000	hrs	24590-PTF-U0D-W16T-00001	E-Note 1
DBE Radiation Dose Rate (mR/hr)	991000 (E-Note 4)	0 (E-Note 5)	yrs	24590-PTF-U0D-W16T-00001	E-Note 1
Flood Height (ft)	2.08	1000	hrs	24590-PTF-U0D-W16T-00001	E-Note 1
Submergence (ft)	N/A	N/A	N/A	N/A	E-Note 6
Chemical/Spray Exposure	 Yes	N/A	N/A	24590-PTF-U0D-W16T-00001	E-Note 1
Additional DBE Information	100c = 100% RH condensing				



EQUIPMENT QUALIFICATION DATASHEET (EQD)

24590-PTF-MVD-HLP-00007
Rev.: 8

Page 16 of 17

DBE Chemical Exposure Details	
DBE Chemical Types/Concentrations	Process Rad Condensate Nitric Acid 2M Sodium Hydroxide 2M, 5M Neutral Solution Water (Ref - 24590-PTF-U0N-W16T-00006) <div style="text-align: right; margin-top: 10px;"> </div>

Interfaces (Electrical)	
Power Supply Voltage (VAC, VDC)	N/A
Power Supply Frequency (Hz)	N/A
Power Connection Method	N/A
I/O Signals to/from Equipment	N/A
I/O Connection Method	N/A

Interfaces (Mechanical)	
Mounting Configuration (orientation)	Vertical Mounted , Skirt
Mounting Method (bolts, welds, etc.)	Welded skirt to ring beam welded to embedment plates. Embedment plate details per 24590-PTF-DD-S13T-00039, 24590-PTF-DD-S13T-00036, 24590-PTF-DD-S13T-00042, and 24590-PTF-DD-S13T-00045 provided to the vendor in the material requisition
Auxiliary Devices	Pulse Jet Mixers - HLP-PJM-00060, HLP-PJM-00061, HLP-PJM-00062, HLP-PJM-00063, HLP-PJM-00064, HLP-PJM-00065, HLP-PJM-00066, HLP-PJM-00067. Auxiliary Devices are located within the vessel.

Equipment Seismic Qualification (ESQ)				
Parameter	Title	Reference/Document Number	Version / Revision	Remarks
WTP Seismic Design Specification (BUYER)	Engineering Specification for Seismic Qualification of Seismic Category I/II Equipment and Tanks	24590-WTP-3PS-SS90-T0001	2	N/A
	Engineering Specification for Seismic Qualification Criteria for Pressure Vessels	24590-WTP-3PS-MV00-T0002	3	
Specified Seismic Load (BUYER)	Seismic Analysis of Pretreatment Building - WSGM In-Structure Response Spectra (ISRS)	24590-PTF-S0C-S15T-00057	A	CCN 185271: WSGM ISRS Curves; Figures 21E, 22E, and 24E
Design Seismic Load (SELLER)	TBD	TBD	TBD	E-Note 3
Qualification Method (SELLER)	TBD	TBD	TBD	Dynamic Analysis utilizing response spectra curves
Qualification Report Number (SELLER)	TBD	TBD	TBD	E-Note 3
Submittal Number (BUYER)	TBD	TBD	TBD	N/A



EQUIPMENT QUALIFICATION DATASHEET (EQD)

24590-PTF-MVD-HLP-00007
Rev.: 8

Page 17 of 17

Equipment Qualification Notes and Additional Information
E-Note 1: BNI (BUYER) shall perform Equipment Environmental Qualification .
E-Note 2: Where pressure is given in inches of water column (in-w.c.) in the source document, it is generally assumed that this is in reference to atmospheric pressure and is therefore equivalent to inches of water gage (in-w.g.).
E-Note 3: SELLER shall perform Equipment Seismic Qualification.
E-Note 4: Radiation Dose Rates are for determining shielding requirements only for the black cell and are not at the source (vessel). Since the vessel is all metallic and the source has no neutron components for material embrittlement, the dose rates are of no concern on the vessel or its subcomponents.
E-Note 5: Normal, Abnormal, and DBE dose rates are the same, therefore, abnormal & DBE doses do not add to total integrated dose based on normal dose rates over 40 years.
E-Note 6: Flood height is 2.08 ft above the floor, bottom of vessel is above this level, therefore, no submergence evaluation is required.

DOE Radioactive Materials Disclaimer:

Please note that source, special nuclear and byproduct materials, as defined in the Atomic Energy Act of 1954 (AEA), are regulated at the US Department of Energy (DOE) facilities exclusively by DOE acting pursuant to its AEA authority. DOE asserts, that pursuant to the AEA, it has sole and exclusive responsibility and authority to regulate source, special nuclear, and byproduct materials at DOE-owned nuclear facilities. Information contained herein on radionuclides is provided for process description purposes only.

Screening / Evaluation Required? If yes per 24590-WTP-GPP-SREG-002, E&NS signature required below	X	Yes		No
---	---	-----	--	----

Approval

Rev	Description	System Engineer	Vessel Engineer	Checked	Reviewed/ MET	E&NS	Approved	Date
0	Issued for Purchase	R. Rider	Suharto	U. Sen C. Slater	N/A	N/A	S. Kirk	10/03/02
1	Revised as Marked, Delete Charge Vessel and RFD per Rev. 0 P&ID	R. Rider	Suharto	S. Arora C. Slater	N/A	N/A	M. Hoffmann	07/10/03
2	Revised Parent Vessel Component Function and Life Cycle Description, Vessel Operating and Design Temperatures, Jacket Design Temperature, and Content Cyclic Data. Other Revisions are for Clarity and Consistency.	R. Rider	R. Simmons	Y. Hovanski C. Slater	R. Stevens	N/A	M. Hoffmann	11/14/03
3	Added Black Cell Requirements	R. Rider	R. Simmons	Y. Hovanski C. Slater	N/A	N/A	M. Hoffmann	02/04/04
4	Added Non-Newtonian Mixing Requirements	R. Rider	R. Simmons	Y. Hovanski C. Slater	J. Julyk	N/A	M. Hoffmann	04/28/04
5	Revised concrete for cluster fill per note 11. Deleted note 10. Revised overflow condition loads. Number of overflow cycles revised to 1000 from 100.	R. Rider	H. Khurana	M. Arulampalam	R. Stevens	N/A	S.V./ M. Hoffmann	06/30/05
6	Revised per note 12 on sheet 2 of 5	R. Rider	M. Arulampalam	J. Polani	C. Slater/ D. Adler	N/A	J. Julyk	10/28/05
7	Revised per Note 14 on sheet 2.	R. Rider	B. Makadia	R. Peters/ M. Seed	D. Adler	G. Hendricks for J. Hinckley	J. Julyk	02/13/08
8	Incorporated 24590-QL-MRB-MVA0-00001-T0001, 24590-QL-MRB-MVA0-00001-T0007. Revised per Note 15.	D. Evans 	B. Makadia 	M Seed 	D. Adler 	J. Hinckley 	J. Julyk 	3/14/11

Data	Document #	Rev	Document Title/ Comments
Quality Level	24590-PTF-M6-HLP-00001001	0	<i>P&ID - PTF HLW LAG Storage and Feed Blending Process System Vessel HLP-VSL-00027A</i>
	24590-PTF-M6-HLP-00001002	0	<i>P&ID - PTF HLW LAG Storage and Feed Blending Process System Vessel HLP-VSL-00027B</i>
	24590-PTF-M6-HLP-00003001	0	<i>P&ID - PTF HLW LAG Storage and Feed Blending Process System Vessel HLP-VSL-00028</i>
Seismic Category	24590-PTF-M6-HLP-00001001	0	<i>P&ID - PTF HLW LAG Storage and Feed Blending Process System Vessel HLP-VSL-00027A</i>
	24590-PTF-M6-HLP-00001002	0	<i>P&ID - PTF HLW LAG Storage and Feed Blending Process System Vessel HLP-VSL-00027B</i>
	24590-PTF-M6-HLP-00003001	0	<i>P&ID - PTF HLW LAG Storage and Feed Blending Process System Vessel HLP-VSL-00028</i>
Design Specific Gravity	24590-WTP-RPT-ENG-07-007	0	<i>Process Stream Properties, Table 4.20</i>
Max Operating Volume	24590-PTF-M6C-HLP-00003	F	<i>Vessel Sizing Calculation for HLW LAG Storage Vessels (HLP-VSL-00027A/B)</i>
	24590-PTF-M6C-HLP-00004	F	<i>Vessel Sizing Calculation for HLW Feed Blending Process Vessel (HLP-VSL-00028)</i>
Total Volume	24590-PTF-M6C-HLP-00003	F	<i>Vessel Sizing Calculation for HLW LAG Storage Vessels (HLP-VSL-00027A/B)</i>
	24590-PTF-M6C-HLP-00004	F	<i>Vessel Sizing Calculation for HLW Feed Blending Process Vessel (HLP-VSL-00028)</i>
Inside Diameter	24590-PTF-M6C-HLP-00003	F	<i>Vessel Sizing Calculation for HLW LAG Storage Vessels (HLP-VSL-00027A/B)</i>
	24590-PTF-M6C-HLP-00004	F	<i>Vessel Sizing Calculation for HLW Feed Blending Process Vessel (HLP-VSL-00028)</i>
Length TL-TL	24590-PTF-M6C-HLP-00003	F	<i>Vessel Sizing Calculation for HLW LAG Storage Vessels (HLP-VSL-00027A/B)</i>
	24590-PTF-M6C-HLP-00004	F	<i>Vessel Sizing Calculation for HLW Feed Blending Process Vessel (HLP-VSL-00028)</i>
Operating Pressure (external)	24590-PTF-M6C-PVP-00017	A	<i>HADCRT Analysis of PTF PVP System at Various Operating Scenarios, Scrubber controlled at -35 in wg (1.3 psig) with an additional margin.</i>
Operating Pressure (internal)	24590-PTF-MVC-10-00003	C	<i>PTF Vessel Cyclic Datasheet Inputs</i>
Design Pressure (external)	24590-PTF-M6C-PVP-00017	A	<i>HADCRT Analysis of PTF PVP System at Various Operating Scenarios, Scrubber controlled at -35 in wg (1.3 psig) with an additional margin.</i>
Design Pressure (internal)	24590-WTP-DB-ENG-01-001	10	<i>Basis of Design</i>
Jacket Design Pressure (internal)	24590-PTF-MVC-10-00003	C	<i>PTF Vessel Cyclic Datasheet Inputs</i>
Operating Temp	24590-PTF-MVC-10-00003	C	<i>PTF Vessel Cyclic Datasheet Inputs</i>
	24590-PTF-MVC-HLP-00010	E	<i>Design of Cooling Jacket for HLW LAG Storage Vessels (HLP-VSL-00027A/B), Section 7.3</i>
	24590-PTF-MVE-HLP-00009	N/A	<i>Transient Cool-down Calculation of HLP-VSL-00027B for Different Levels (applies to HLP-27A & 27B)</i>
	24590-PTF-MVC-HLP-00011	E	<i>Design of Cooling Jacket for HLW Feed Blending Vessel (HLP-VSL-00028), Section 7.3</i>
	24590-PTF-MVE-HLP-00011	N/A	<i>Transient Cool-down Calculation of HLP-VSL-00028 for Different Levels</i>
Design Temp	24590-WTP-GPG-M-050	2	<i>Pressure Vessel and Heat Exchanger Design</i>

Data	Document #	Rev	Document Title/ Comments
Jacket Design Temp	24590-WTP-GPG-M-050	2	Pressure Vessel and Heat Exchanger Design
Corrosion Allowance, Erosion Allowance (Note 1 and Note 2)	24590-PTF-N1D-HLP-00007	6	HLP-VSL-00027A&B (PTF) HLW LAG Storage Vessel
	24590-PTF-N1D-HLP-00010	6	HLP-VSL-00028 (PTF) HLW Feed Blending Vessel
Materials of Construction	24590-PTF-N1D-HLP-00007	6	HLP-VSL-00027A&B (PTF) HLW LAG Storage Vessel
	24590-PTF-MV-HLP-00006	2	Equipment Assembly HLW LAG Storage Vessel HLP-VSL-00027A
	24590-PTF-MV-HLP-00005	2	Equipment Assembly HLW LAG Storage Vessel HLP-VSL-00027B
	24590-PTF-N1D-HLP-00010	6	HLP-VSL-00028 (PTF) HLW Feed Blending Vessel
	24590-PTF-MV-HLP-00004	2	Equipment Assembly HLW Feed Blend vessel HLP-VSL-00028
Design Pressure (PJM)	24590-BOF-M6C-PSA-00001	B	Plant Service Air System Sizing
	24590-PTF-MVE-10-00012	N/A	Update PJM Cyclic Data and supporting assumptions
Operating Pressure (PJM)	24590-PTF-MVC-10-00003	C	PTF Vessel Cyclic Datasheet Inputs
	24590-PTF-MVE-10-00012	N/A	Update PJM Cyclic Data and supporting assumptions
Operating Temperature (PJM)	24590-PTF-M6C-HLP-00003	F	Vessel Sizing Calculation for HLW LAG Storage Vessels (HLP-VSL-00027A/B)
	24590-PTF-M6C-HLP-00004	F	Vessel Sizing Calculation for HLW Feed Blending Process Vessel (HLP-VSL-00028)
Cyclic Data (Vessel)	24590-PTF-MVC-10-00003	C	PTF Vessel Cyclic Datasheet Inputs
	24590-PTF-MVE-10-00006	N/A	Change assumed number of cycles for HLP-VSL-00027B and HLP-VSL-00028
Cyclic Data (PJM)	24590-PTF-MVC-10-00003	C	PTF Vessel Cyclic Datasheet Inputs
	24590-PTF-MVE-10-00012	N/A	Update PJM Cyclic Data and supporting assumptions
	24590-WTP-M6C-50-00011	A	Pulse Jet Mixer Internal Pressures and Thrust
Hydrodynamic Loads Vortex Shedding	24590-WTP-MVC-50-00006	A	Hydrodynamic Loads for Normal PJM Operation in Vessels With Non-Newtonian Fluids
	24590-WTP-MVC-50-00006	A	Hydrodynamic Loads for Normal PJM Operation in Vessels With Non-Newtonian Fluids
Hydrodynamic Loads (Cycles)	24590-PTF-MVE-10-00012	N/A	DCN to 24590-PTF-MVC-10-00003, Update PJM Cyclic Data and supporting assumptions, hydrodynamic load cycles are based on PJM operating cycles.
Single PJM Overblow Loads	24590-WTP-MVC-50-00008	C	Hydrodynamic Loads for PJM Overblow in Vessels With Non-Newtonian Fluids
PJM Overblow Loads	24590-WTP-MVC-50-00011	B	Pulse Jet Mixer Overblow Vessel Loads
Single Overblow Cycles	24590-PTF-MVC-10-00003	C	PTF Vessel Cyclic Datasheet Inputs
	24590-PTF-MVE-10-00004	N/A	Add PJM Overblow Frequency Assumption

Data	Document #	Rev	Document Title/ Comments
Multiple Overblow Cycles	24590-PTF-MVC-10-00003 24590-PTF-MVE-10-00004	C N/A	<i>PTF Vessel Cyclic Datasheet Inputs</i> <i>Add PJM Overblow Frequency Assumption</i>
Nozzle Loads	CCN 124018 (HLP-27A) CCN 204141 (HLP-27A) CCN 230850 (HLP-27A) CCN 151556 (HLP-27B) CCN 204151 (HLP-27B) CCN 229174 (HLP-27B) CCN 229176 (HLP-27B) CCN 230851 (HLP-27B) CCN 126208 (HLP-28) CCN 191682 (HLP-28) CCN 230852 (HLP-28) 24590-WTP-RPT-ENG-09-040	N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A 0	<i>Nozzle Design Loads for HLP-VSL-00027A</i> <i>Supplemental Nozzle Loads for HLP-VSL-00027A N29, N30, N33, N34, N37</i> <i>Supplemental Nozzle Loads for HLP-VSL-00027A Camera Port Nozzles (N76, N77)</i> <i>Nozzle Design Loads for HLP-VSL-00027B</i> <i>Supplemental Nozzle Loads for HLP-VSL-00027B N29 and N30 revised</i> <i>Supplemental Nozzle Loads for HLP-VSL-00027B Nozzle N02</i> <i>Supplemental Nozzle Loads for HLP-VSL-00027B N32, N38, N41</i> <i>Supplemental Nozzle Loads for HLP-VSL-00027B Camera Port Nozzles (N80, N81)</i> <i>Nozzle Design Loads for HLP-VSL-00028</i> <i>Supplemental Nozzle Loads for HLP-VSL-00028 N29 and N30 revised</i> <i>Supplemental Nozzle Loads for HLP-VSL-00028 Camera Port Nozzles (N80, N81)</i> <i>Seismic Classification and Evaluation for the PTF Facility Piping and Vessels / Section 3.2 page 19, for 1.75 seismic factor to RGM nozzle loads</i>

- Notes:
1. Vessel bottom head - additional erosion allowance from reference 24590-WTP-M0C-50-00004 Rev E, Table 10-7 (24590-WTP-M0E-50-00014 Attachment 10-11) shows a vessel erosion allowance of 0.768" (max) for HLP-VSL-000027A/B and 0.903" (max) for HLP-VSL-00028. This erosion allowance is accounted for via the 1" thick wear plates installed in the vessel bottom head directly under the PJM outlet nozzle.
 2. PJM additional erosion allowance from reference 24590-WTP-M0C-50-00004 Rev E, Table 10-5, show an erosion allowance of 0.093" (HLP-27A/B) and 0.117" (HLP-28) for the stellite 12 material used in the PJM cones. The minimum thickness requirement for the PJM stellite cone material is 0.4375".