



# Drawing Change Notice

Page 1 of 2

R10738852

CHANGE DOCUMENT NO.  
24590-LAW-M5N-V17T-00019

ISSUED BY  
RPP/WTP/PDC

JOB NO. 24590	TITLE FOR CHANGE NOTICE Add HEPA Filters Before the Inlets to LVP Fans in LVP-SKID-00003	
DESIGN DOCUMENT NUMBER 24590-LAW-M5-V17T-00011	REV NO 5	TITLE OF DESIGN DOCUMENT Process Flow Diagram LAW Vit Secondary Offgas Treatment (System LVP)
PART OF DESIGN CHANGE PACKAGE (DCP)? <input checked="" type="checkbox"/> No <input type="checkbox"/> Yes		DCP No.: _____ Rev: _____
JUSTIFICATION FOR CHANGE HEPA filters will be added before the fans in LVP-SKID-00003 to align with the current design.		TREND CODE-NUMBER N/A
Supersedes Change Document <input checked="" type="checkbox"/> No <input type="checkbox"/> Yes		

### REQUIREMENTS REVIEW

Client Approval Required * <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Permit Review by E&NS Required <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
Interface Resolution Required * <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Safety Screening / Evaluation Required <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
* Address these "yes" answers in the description Documents identified in 24590-WTP-GPP-SREG-002 must be checked "Yes" regardless of the change being made, and E&NS signature is required below.	


### DESCRIPTION OF CHANGE

PFDs are identified in 24590-WTP-GPP-SREG-002 as requiring a safety screening. These changes affect the environmental permit version of this drawing and require a permit review by E&NS.

In Sector 6-A, add HEPA filters before the LVP-FAN-00001/2 inlets.

BEFORE

Please note that source, special nuclear, and byproduct materials, as defined in the Atomic Energy Act of 1954 (AEA) are regulated at the U. S. Department of Energy (DOE) facilities exclusively by DOE acting pursuant to its AEA authority. DOE asserts that pursuant to AEA, it has sole and exclusive responsibility and authority to regulate source, special nuclear, and byproduct materials at DOE-owned nuclear facilities. Information contained herein on radionuclides is provided for process description purposes only.

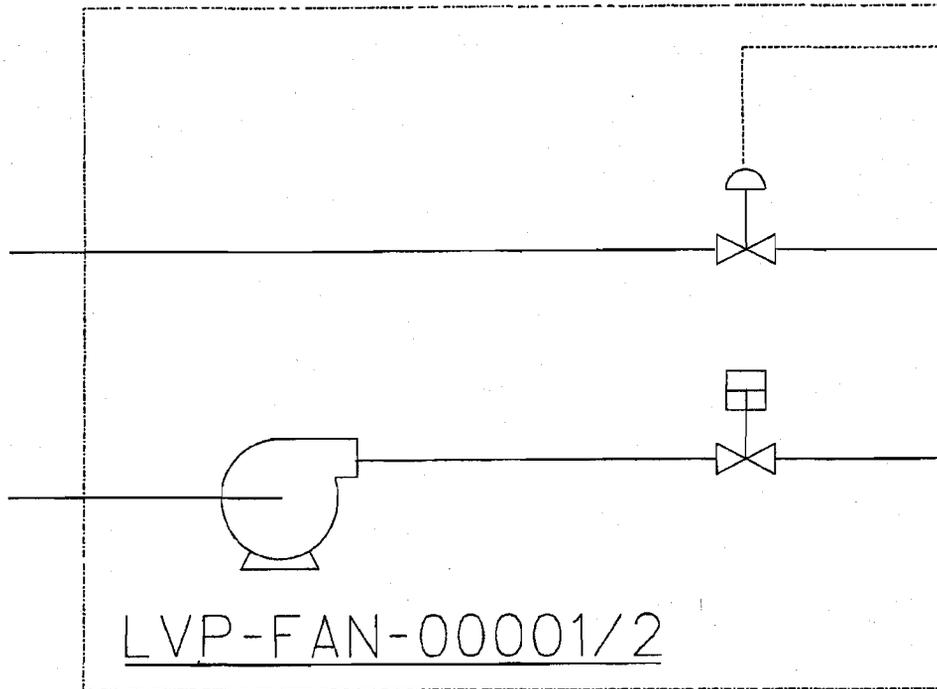

LVP-FAN-00001/2



# Drawing Change Notice


Page 2 of 2

CHANGE DOCUMENT NO.  
24590-LAW-M5N-V17T-00019

JOB NO. 24590	TITLE FOR CHANGE NOTICE Add HEPA Filters Before the Inlets to LVP Fans in LVP-SKID-00003
------------------	---

## DESCRIPTION OF CHANGE

AFTER

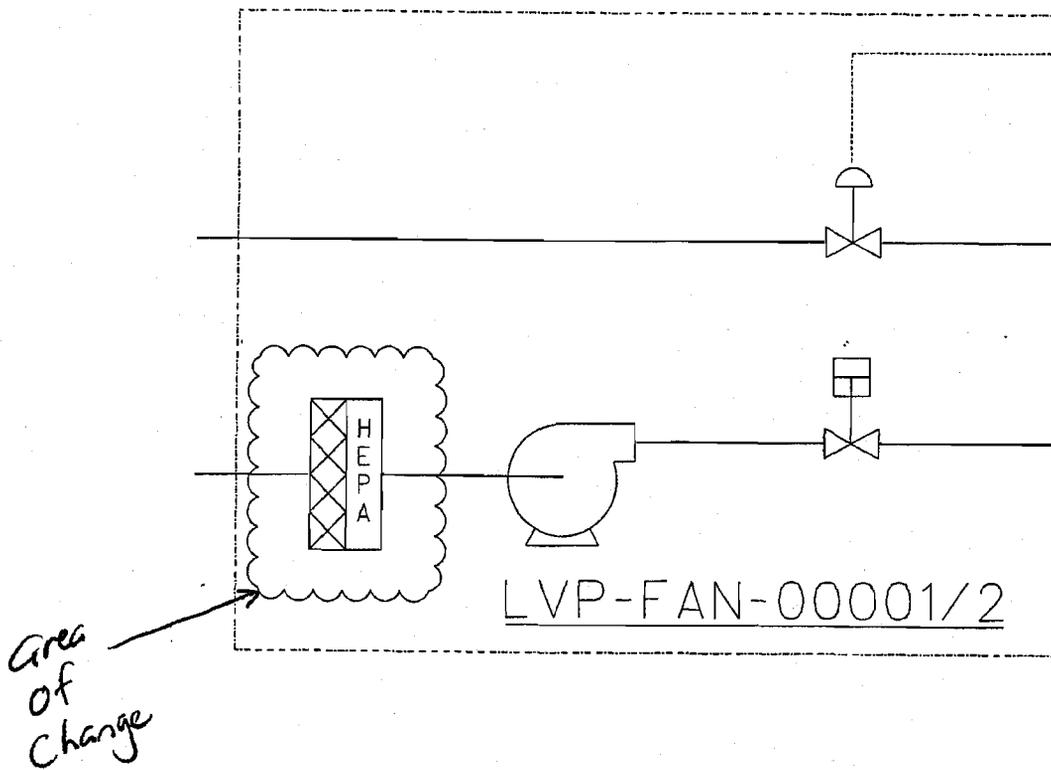

ORIGINATOR N. Wilkins 	CHECKER R. Hanson 	REVIEWER G. Chiaromonte 	
QA (when applicable) N/A	E&NS (when applicable) Dwight Krahn 	APPROVER(S) R. Voke J. Roth	APPROVAL DATE 11/22/06