

NOTES:

1. DO NOT DAMAGE OR DISTURB EXISTING CROSSTIED TIMBERS OR PILES DURING WORK. PILES OR TIMBER BROKEN OFF DURING WORK WILL BE REMOVED AND DISPOSED OF AT THE EXPENSE OF THE CONTRACTOR.
2. DO NOT DAMAGE OUTFALL CONCRETE STRUCTURE DURING SEDIMENT REMOVAL.
3. DO NOT DAMAGE OTHER EXISTING OUTFALLS OR STRUCTURES. REPAIRS TO THESE STRUCTURES FROM CONTRACTOR ACTIVITIES WILL BE MADE AT THE EXPENSE OF THE CONTRACTOR.
4. AFTER SEDIMENT REMOVAL IS COMPLETED, EXTEND NON-WOVEN GEOSYNTHETIC SEPARATION BARRIER MATERIAL 3 FEET BEYOND LIMIT OF DISTURBED SEDIMENT PRIOR TO PLACING SPLASH PAD/COVER MATERIALS.
5. MAINTAIN SPILL RESPONSE EQUIPMENT AND MATERIALS AS REQUIRED BY CONTRACTOR SPEC PLAN.
6. CONTRACTOR SHALL PROVIDE REQUIRED UPRR NOTIFICATION PER SPECIFICATIONS.
7. CONTRACTOR SHALL FOLLOW EQUIPMENT DECONTAMINATION REQUIREMENTS AND TRACK-OUT RESTRICTIONS PER SPECIFICATIONS.
8. MAINTAIN CLEAN OPERATION BETWEEN EXCAVATION AREA AND OFF LOADING AREA. CONTRACTOR SHALL PROPOSE SPECIFIC BMPs TO MINIMIZE SPILLAGE AND COLLECT/CONTAIN ANY SPILLAGE THAT DOES OCCUR. OPERATIONS WILL BE SHUT DOWN AT CONTRACTOR'S EXPENSE UNTIL CONTRACTOR CORRECTS ANY UNCONTROLLED SPILLAGE.

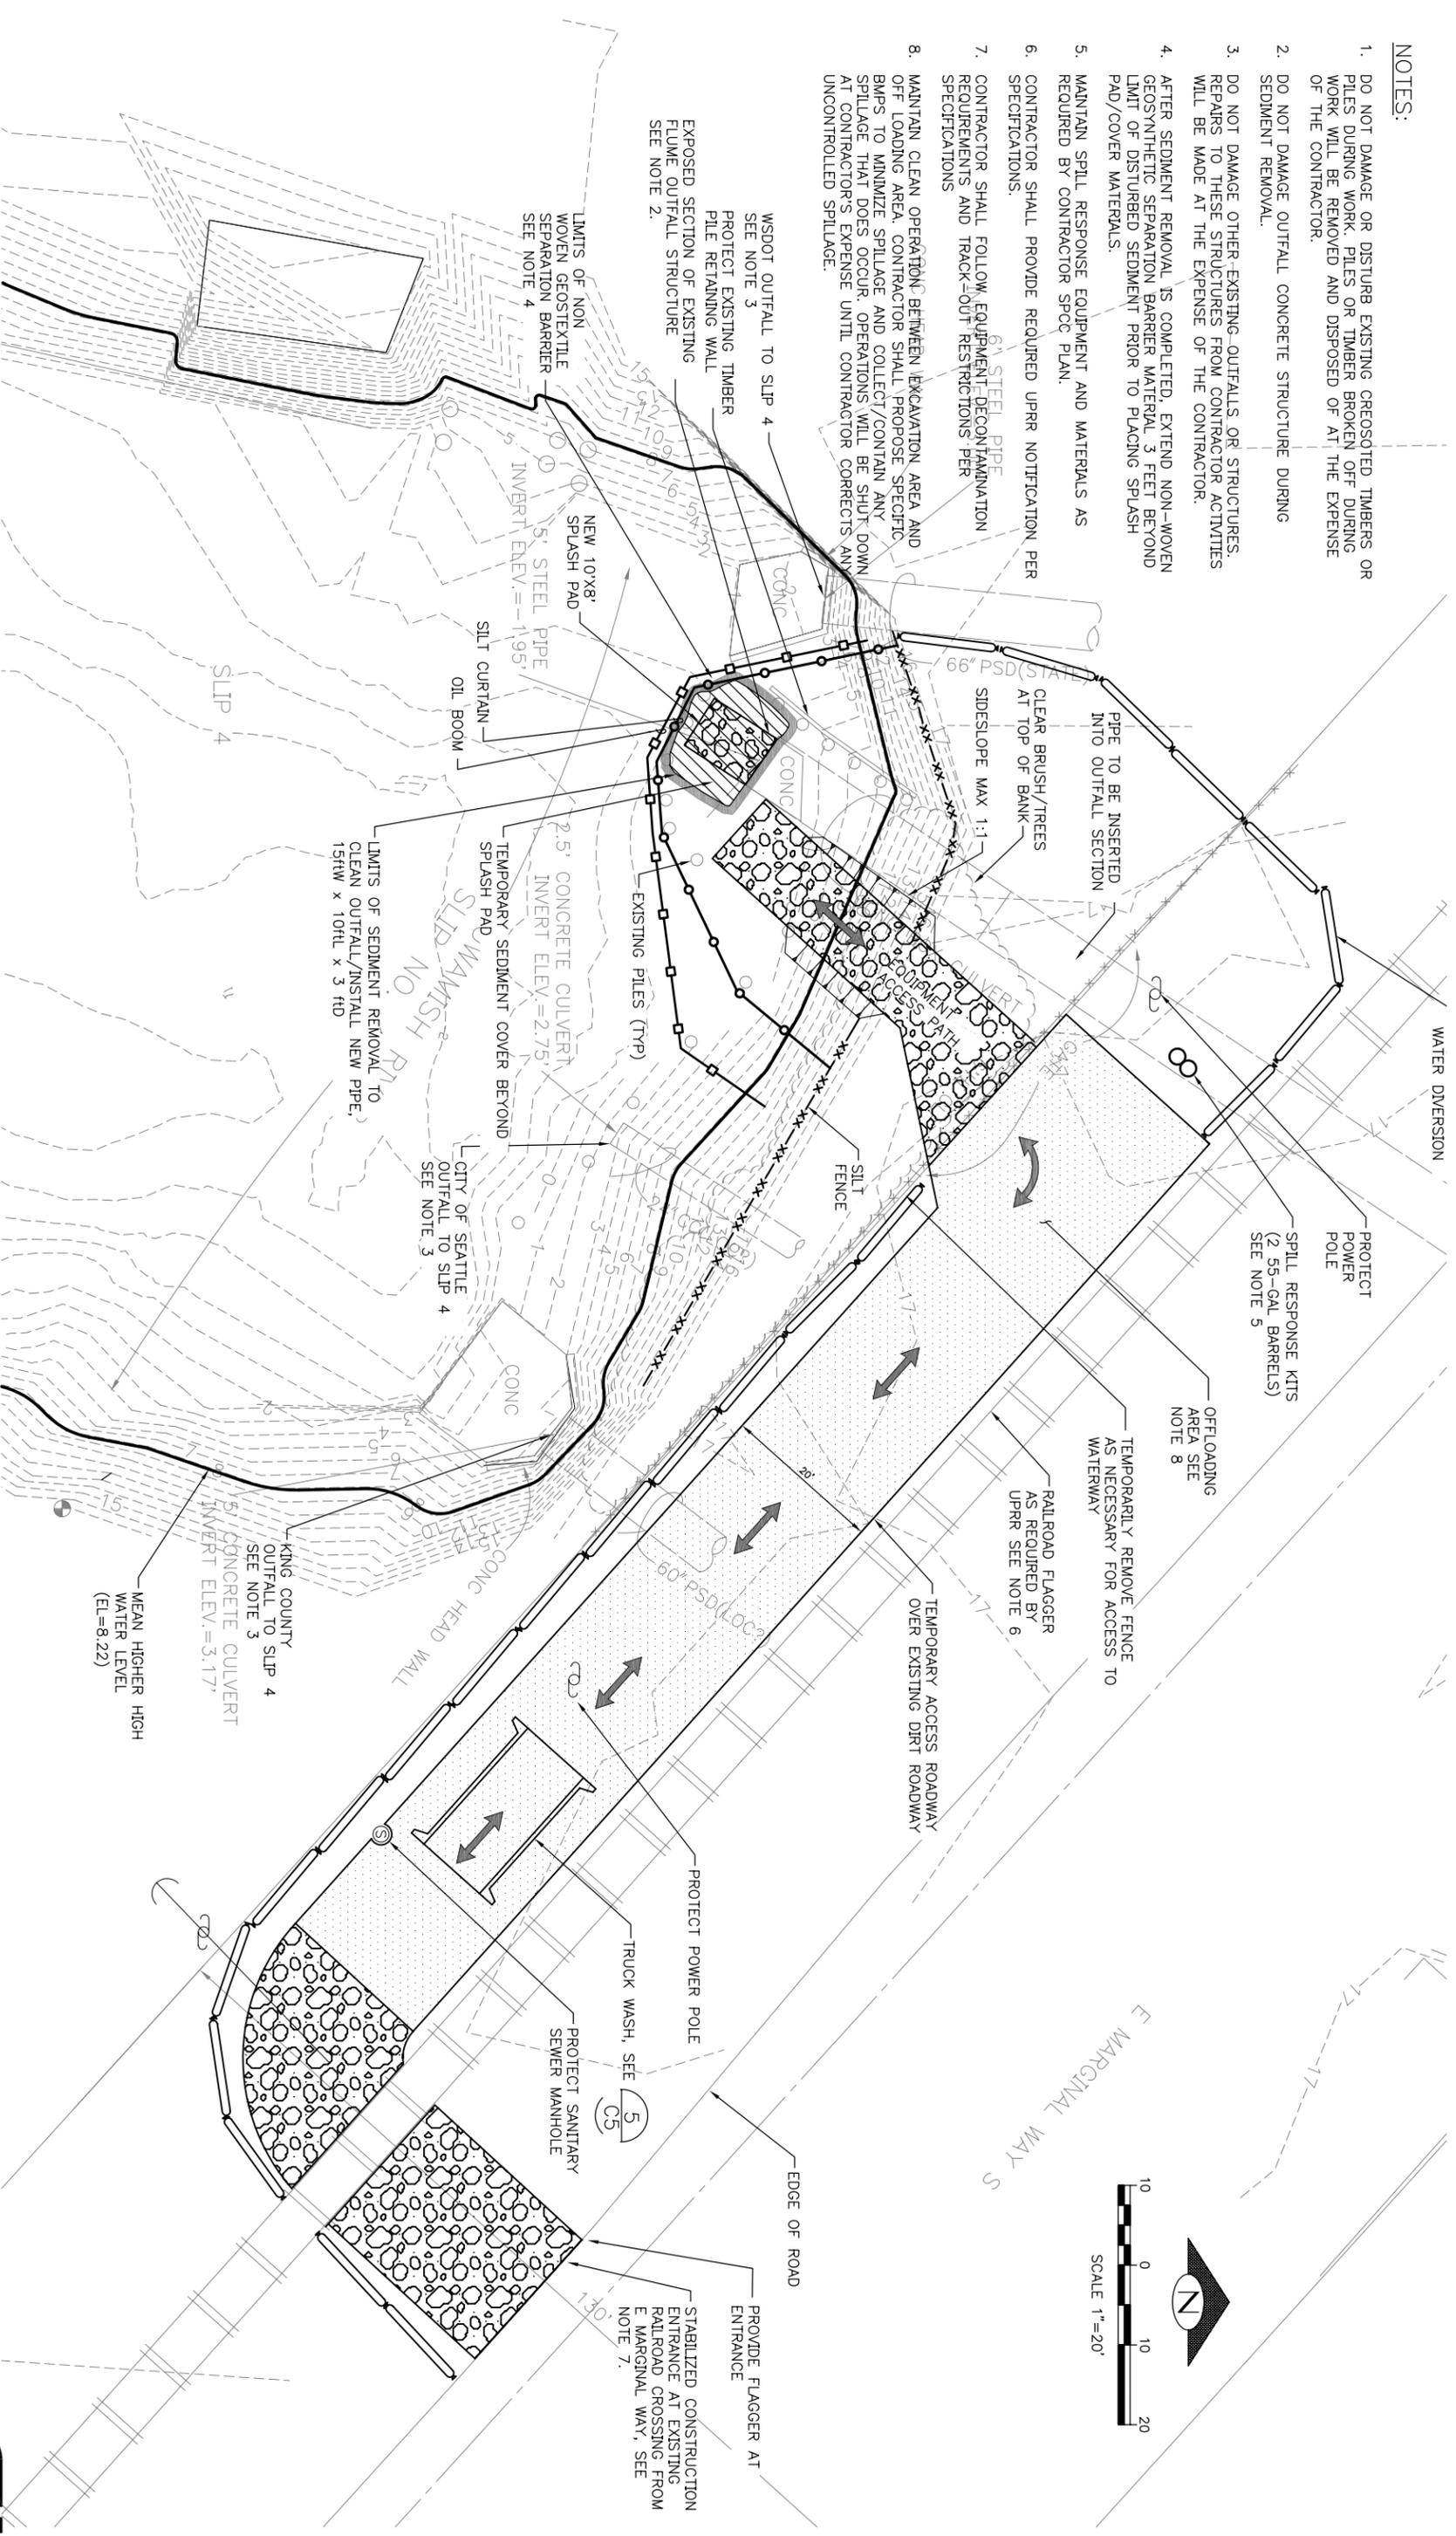


Figure 5 - Slip 4 Shoreline and Outfall Construction Area