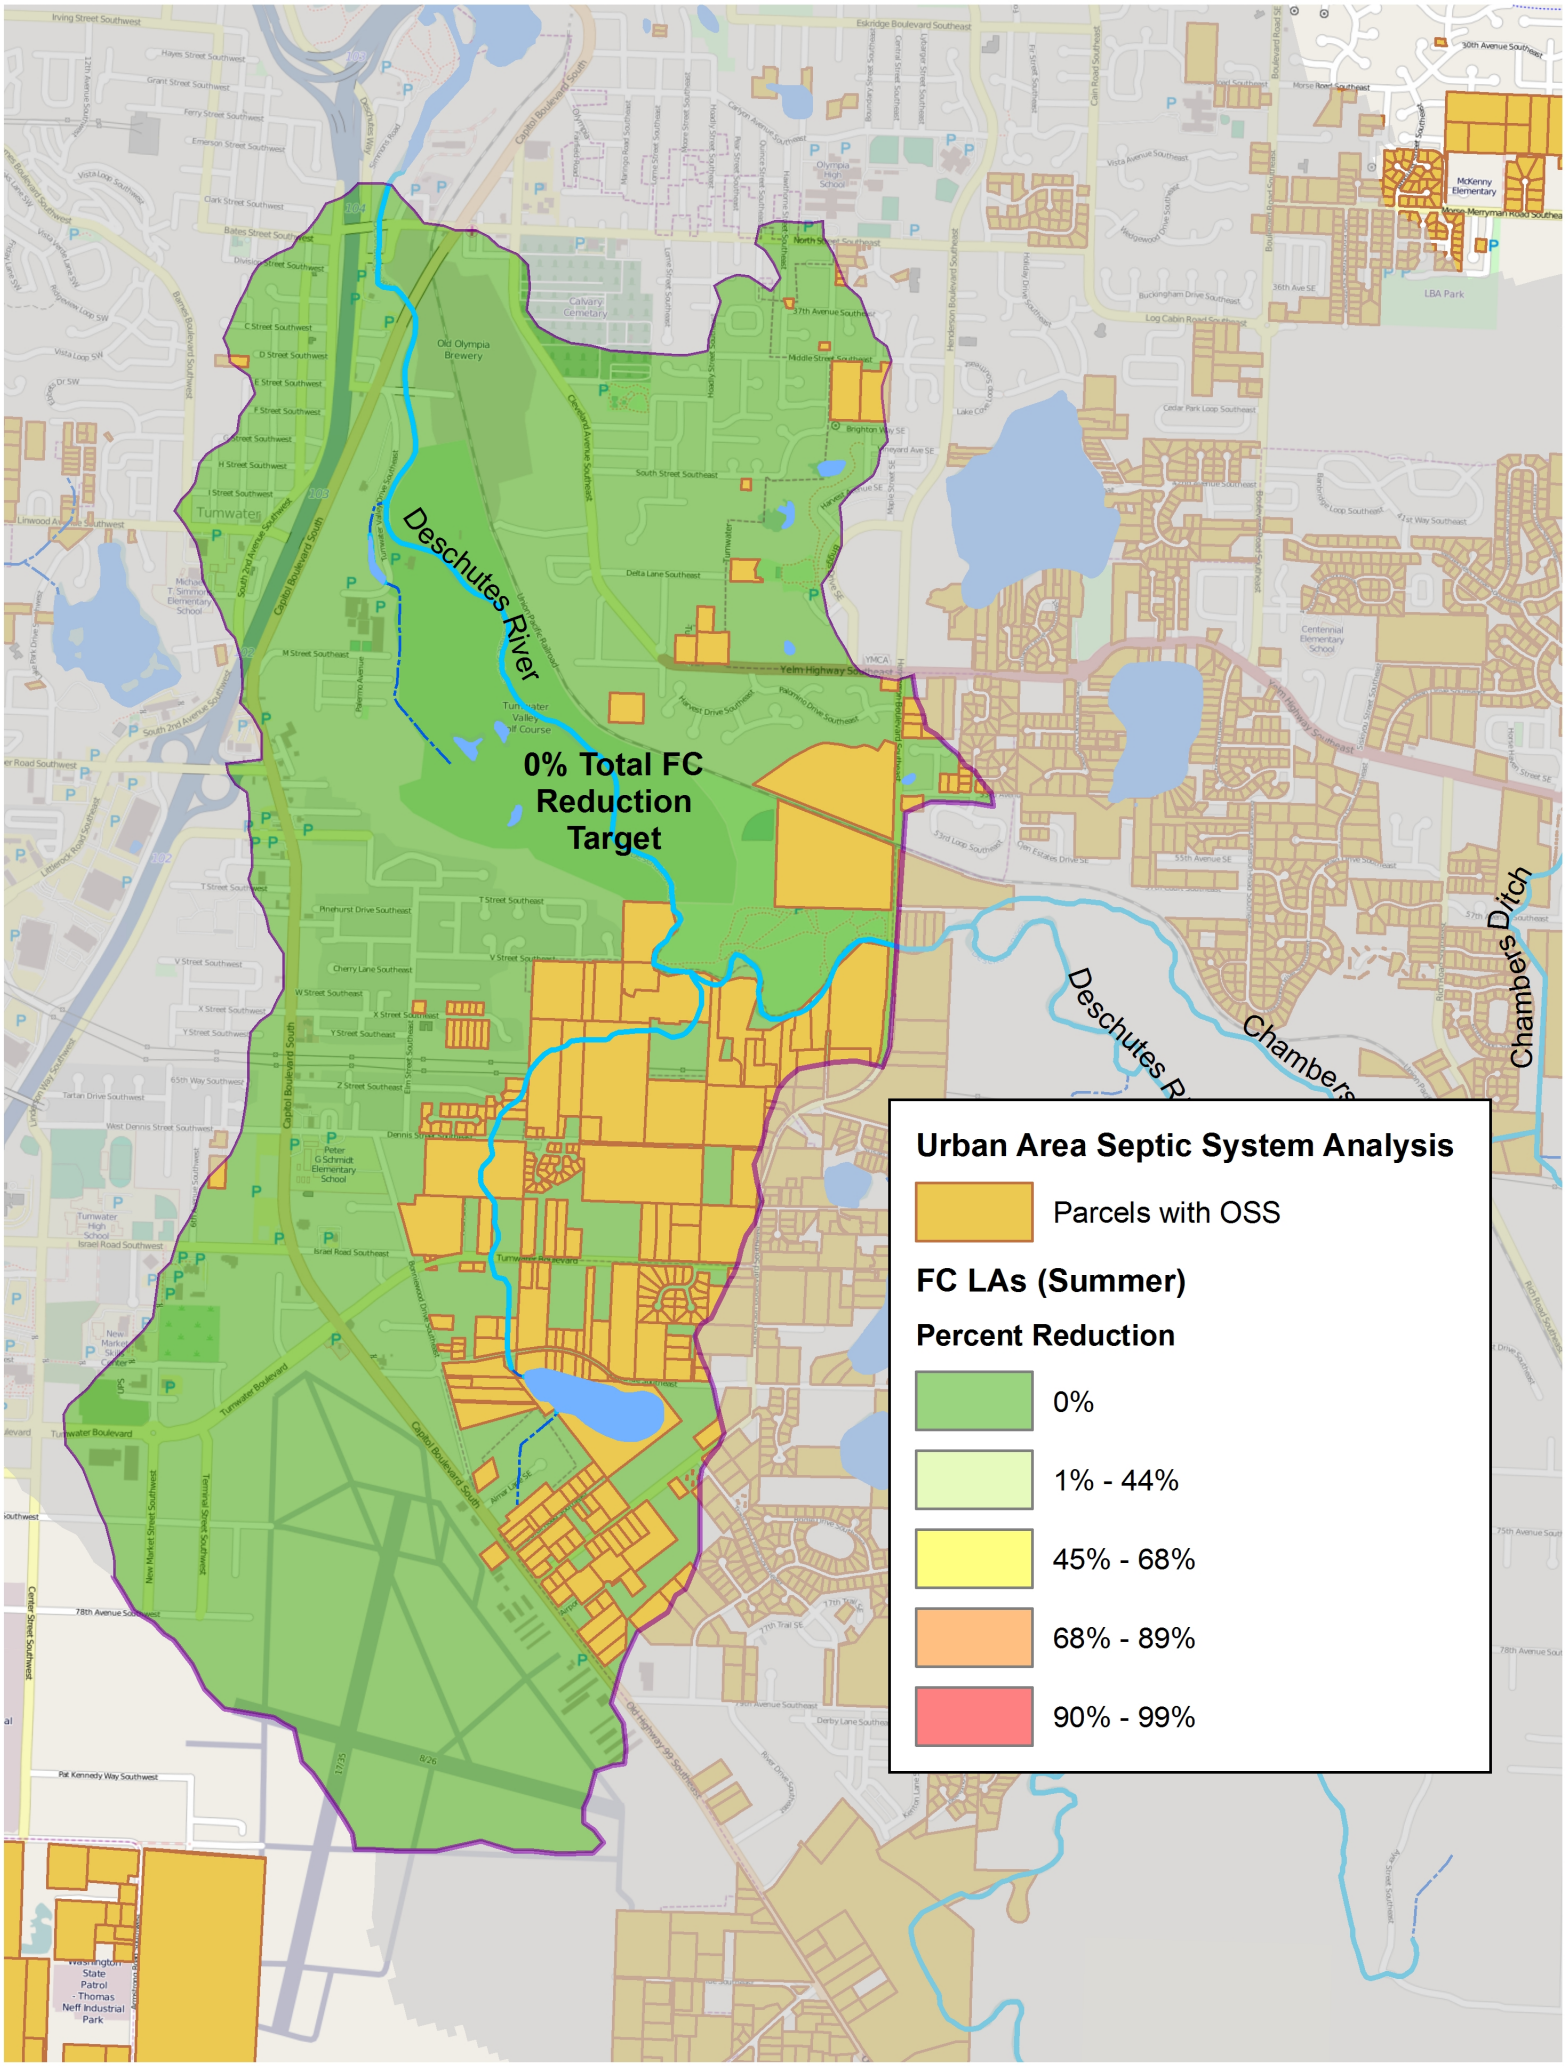
Deschutes River
0% Total FC Reduction Target
Chambers Ditch
Urban Area Septic System Analysis
Parcels with OSS
FC LAs (Summer)
Percent Reduction
0%
1% - 44%
45% - 68%
68% - 89%
90% - 99%